
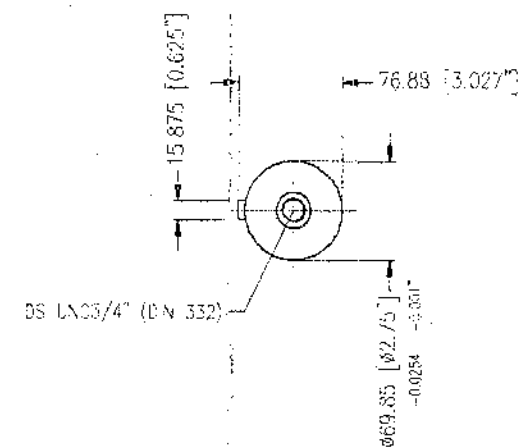
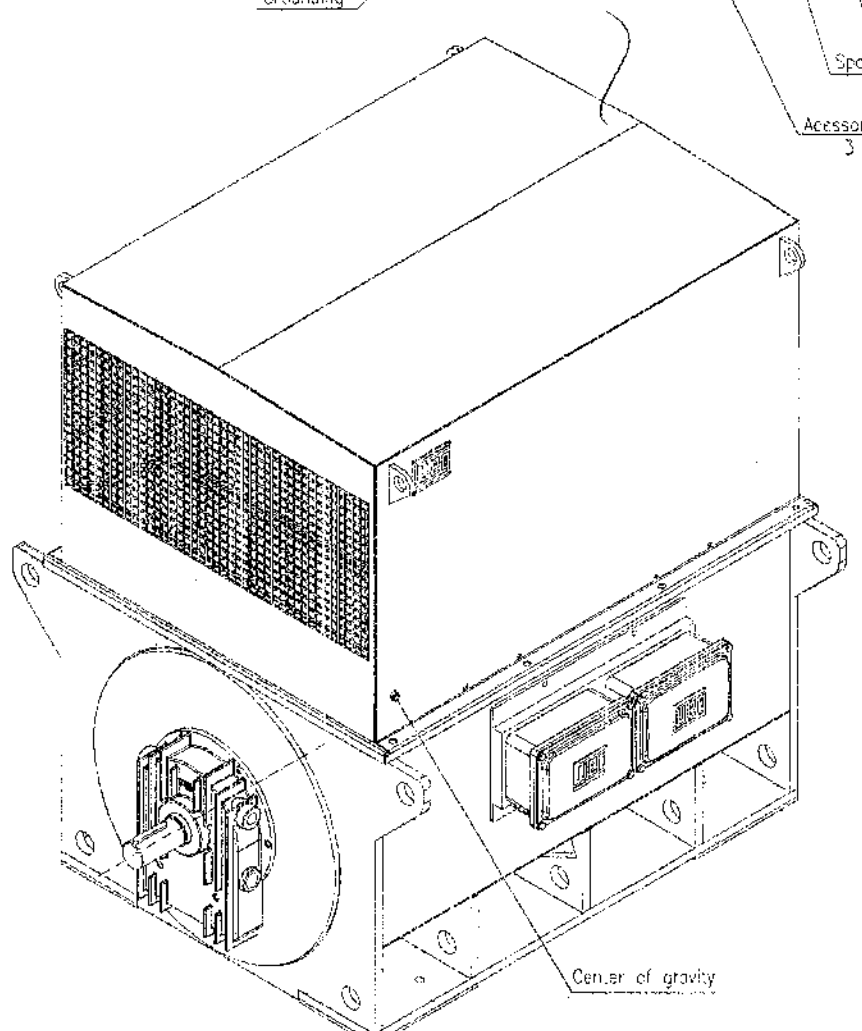


1 2 3 4 5 6 7 8

A
B
C
D
E

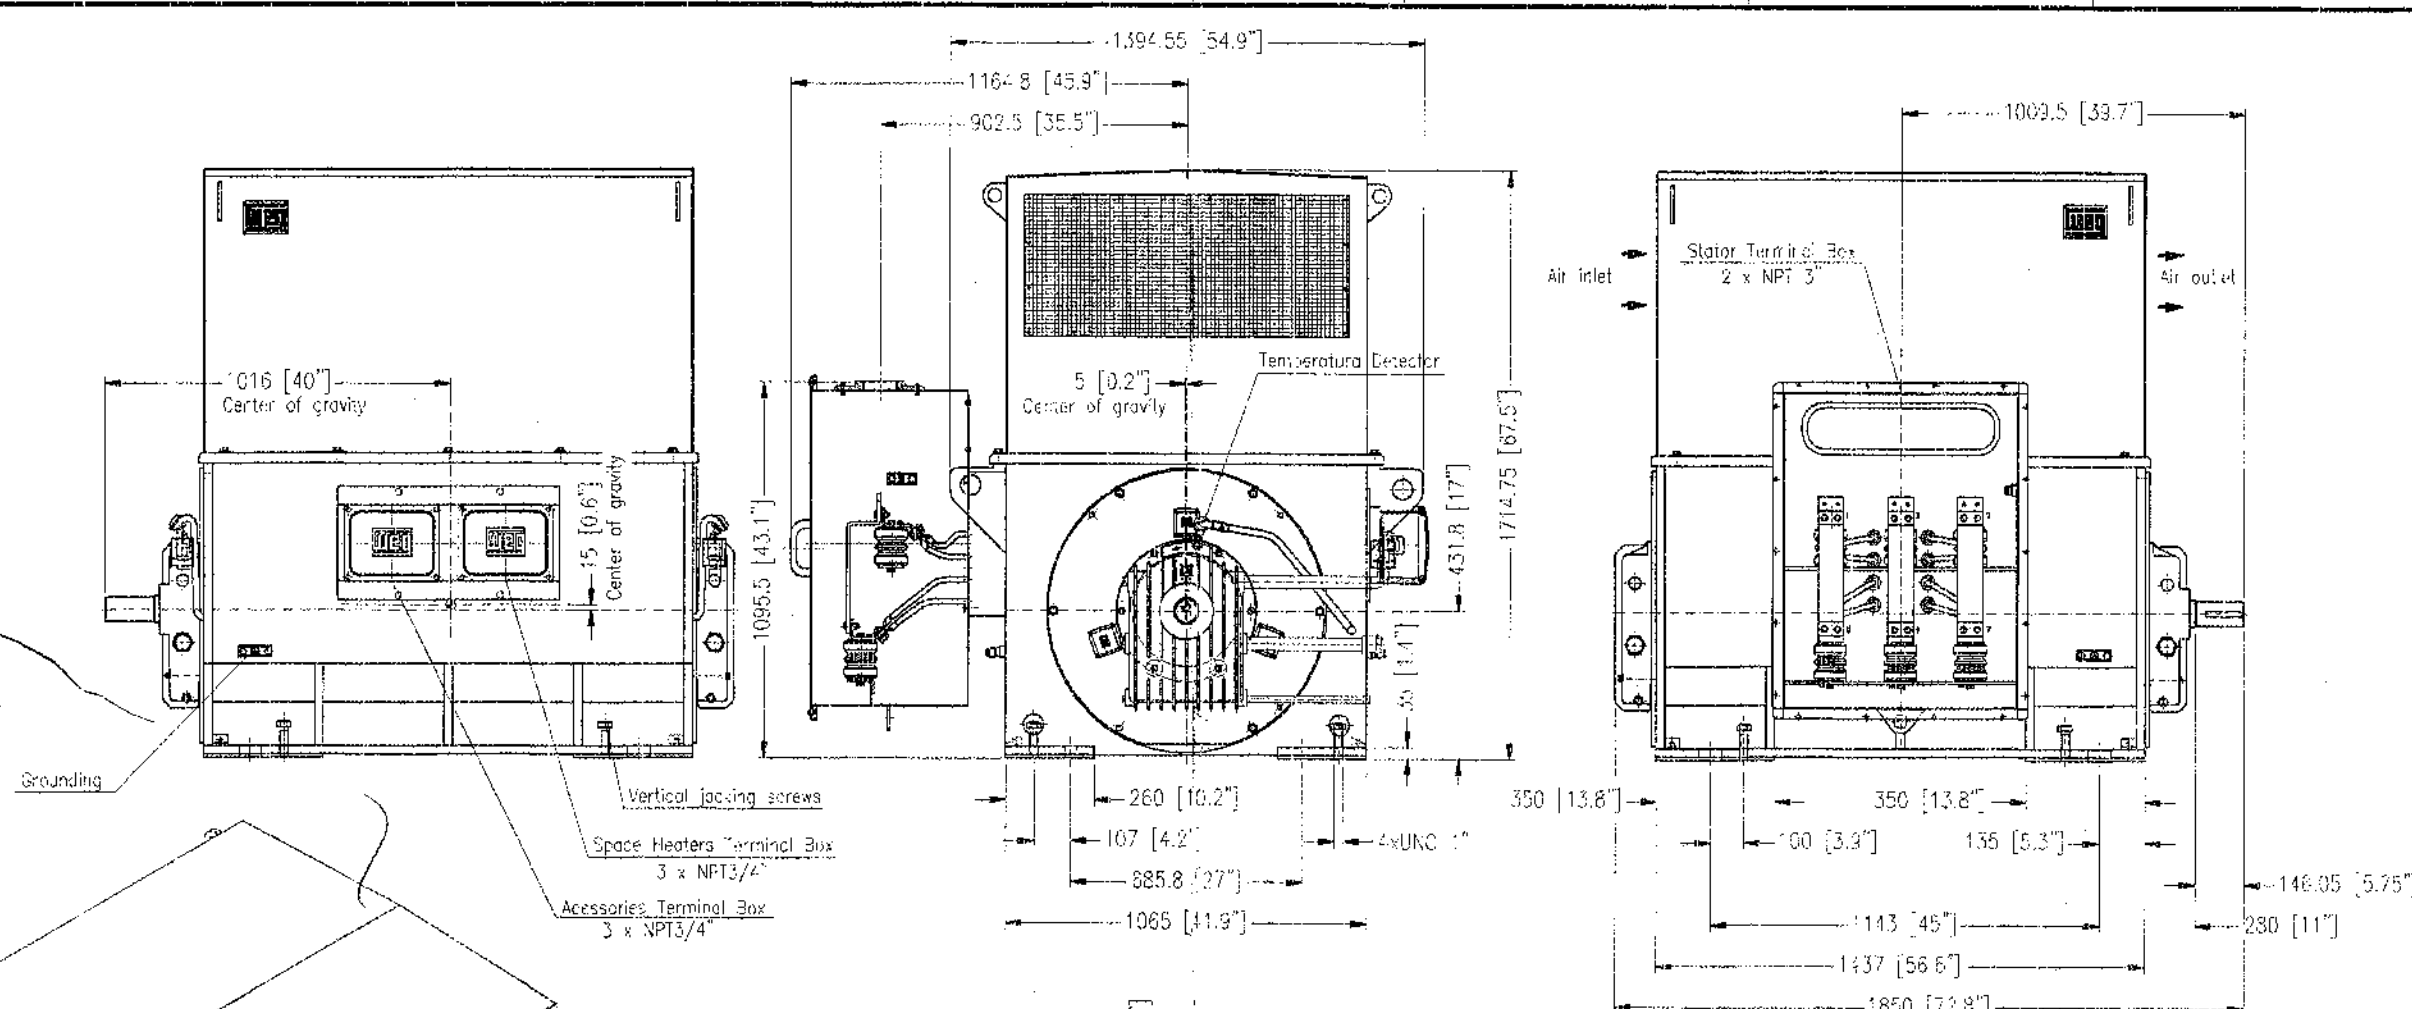

"Turbo Steam Corp - PO# 03241
Job Name: Schweitzer Project # 03154"

FDI: 28100/2003

BEARINGS PROTECTION
ALARM : 90°C
TRIP : 110°C

Protection: MG1-Part 1	IEC 34-5	Weld Const: ISO 8015	Character's (SM): MG1-Part 10 IEC 34-1	Test (SM): MG1-Part 12 IEC 34-2/4
Dimension: MG1-Part 4	IEC 72	Finishing: ISO 2788	Character's (AC): MG1-Part 10 IEC 34-1	Test (AC): MG1-Part 12 IEC 34-2
Tolerance: MG1-Part 4	ISO 288	Cost: ISO 8062	Character's (DC): MG1-Part 10 IEC 34-1	Test (DC): MG1-Part 12 IEC 34-2
Key: MG1-Part 4	ISO R773			

Added view (3)	Teste	Franzner	23.01.04	Wagner	3
Update dimension of Motor	Teste	Ju	20.01.04	Wagner	2
Changes	Exec	Check	Date	Process	NO

Weight (kg)		Material	
Exec	Koradin 02.12.03	Customer	
Check	Dias 03.12.03		
PRC	Wagner 20.01.04		



Bearing		Inter. Lub.(η)	Type Lubrication	Estimated life
Front	6316-C4	8000	ISO VG46 OIL	40000
Rear	6316-C4	8000	ISO VG46 OIL	40000

CERTIFIED
Weg Maquinas Ltda

Reproduction not permitted

DIMENSIONAL MGP6810
840kW - 480V - 2P - 60Hz - WP-II - F-1
9301.2425

Copies: RT

02/03/2004
CLIENTE