






AVERY

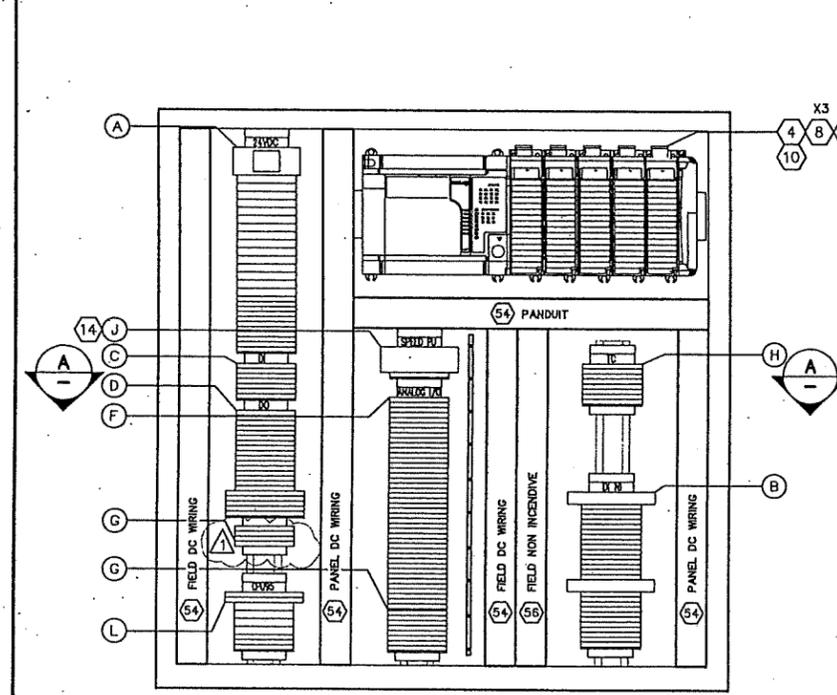

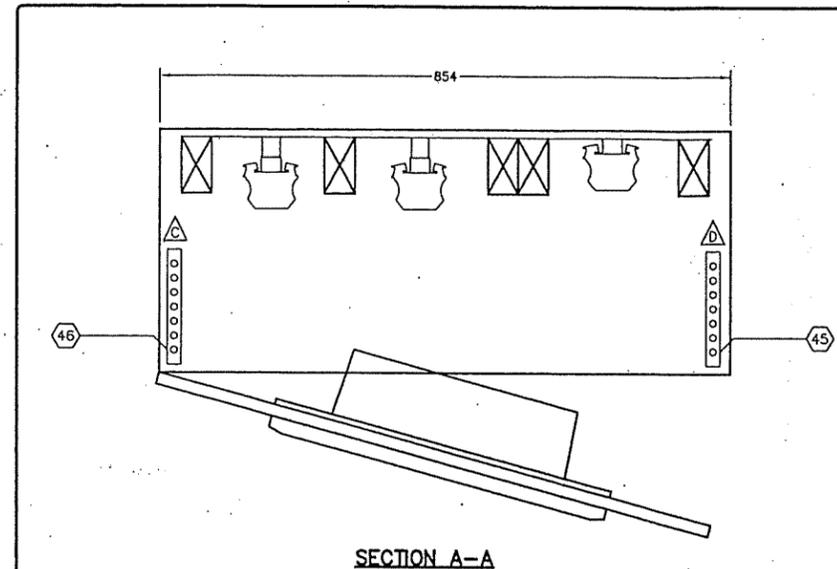

BACK PAN ELEVATION

MATERIAL LIST CROSS REFERENCE		20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	40	51	52	53
A	24VDC DISTRIBUTION		10							3	10										1	1	1
B	DISCRETE INPUTS (N.I.)			2	12							12					2						
C	DISCRETE INPUTS				4							3											
D	DISCRETE OUTPUTS		7								4	4	1								5		
E	ANALOG INPUTS (N.I.)																						
F	ANALOG INPUTS													16									
G	ANALOG OUTPUTS		8				16	0					16										
H	THERMOCOUPLE					6	0								6								
J	ENGINE SPEED PICKUP							1											8				
K	SLIDE VALVE/M CONTROL																						
L	IGNITION		1								3	2								2			1
TOTAL		2	26	2	16	22	1	0	0	6	14	37	1	6	0	0	2	8	0	8	1	1	0
ITEM		20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	40	51	52	53

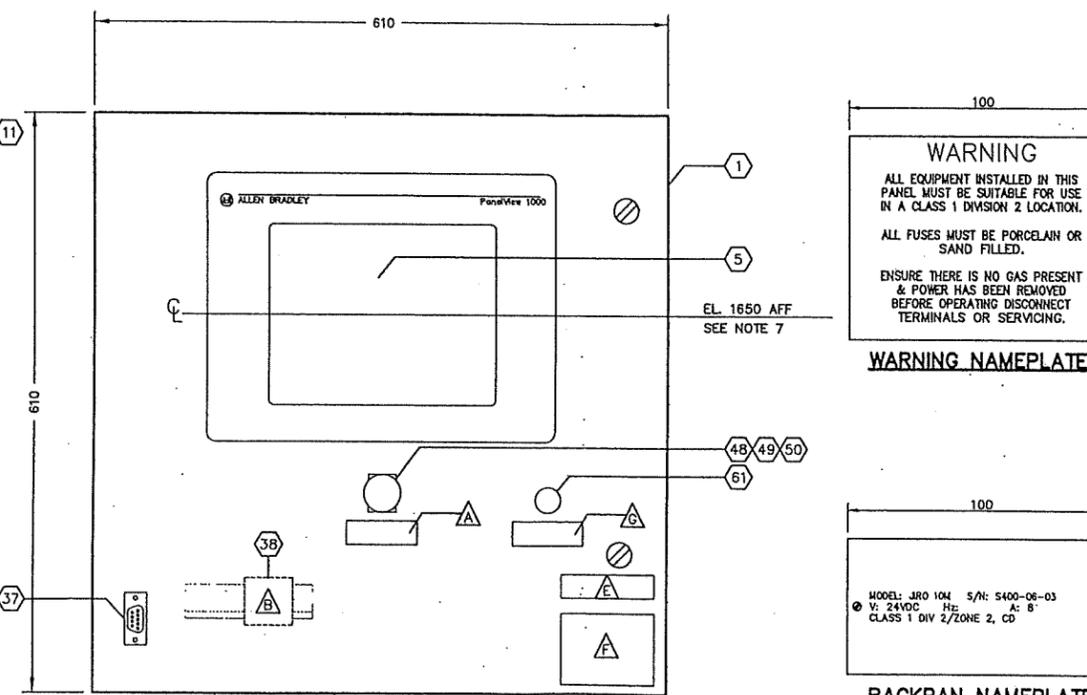

FRONT ELEVATION

MATERIAL LIST		ITEM	QTY	DESCRIPTION	MANUFACTURER	CATALOG No.	SIZE	SUPPLIER
1	1	ENCLOSURE	HOFFMAN	CSD242410		610x610x254	VENDOR	
2	0	PANELVIEW 300 (24VDC)	ALLEN-BRADLEY	2711-K3A5L1			KILOWATTS	
3	0	24VDC POWER SUPPLY	ALLEN-BRADLEY	1769-PB2			KILOWATTS	
4	1	MICROLOGIX PROCESSOR	ALLEN-BRADLEY	1764-LRP			KILOWATTS	
5	1	PANELVIEW 1000 (24VDC)	ALLEN-BRADLEY	2711-T10C9L1			KILOWATTS	
6	1	MICROLOGIX (24VDC)	ALLEN-BRADLEY	1764-288XB			KILOWATTS	
7	0	ANALOG INPUT MODULE	ALLEN-BRADLEY	1769-IF4		4 PT.	KILOWATTS	
8	3	ANALOG INPUT MODULE	ALLEN-BRADLEY	1769SC-IFB1		8 PT.	KILOWATTS	
9	1	ANALOG OUTPUT MODULE	ALLEN-BRADLEY	1769-OF4C1		4 PT.	KILOWATTS	
10	1	ANALOG OUTPUT MODULE	ALLEN-BRADLEY	1769-OF2		2 PT.	KILOWATTS	
11	1	COMPACT I/O END CAP (RIGHT)	ALLEN-BRADLEY	1769-ECR			KILOWATTS	
12	0	THERMOCOUPLE INPUT MODULE	ALLEN-BRADLEY	1769-IT6		6 PT.	KILOWATTS	
13	0	ETHERNET MODULE	ALLEN-BRADLEY	1761-NET-EN1			KILOWATTS	
14	1	SPEED TRANSMITTER	ACROMAG	250T-F01-DIN-DT1			KILOWATTS	
15	1	KIT OF (4) MOUNTING FEET	HOFFMAN	62490 CMFK			VENDOR	
16	AS REQ'D	TERMINAL MOUNTING RAIL	WEIDMULLER	23640		TS 35	VENDOR	
17	AS REQ'D	LABEL DESCRIPTION HOLDER	WEIDMULLER	28246		SCHT-5S	VENDOR	
18	AS REQ'D	TERMINAL END BRACKET	WEIDMULLER	36356		EW35	VENDOR	
19	AS REQ'D	TERMINAL END SECTION	WEIDMULLER	105000		WAP 2.5-10	VENDOR	
20	2	TERMINAL FEED THROUGH (GENERIC)	WEIDMULLER	102000		WDU 2.5	VENDOR	
21	26	TERMINAL FEED THROUGH (YELLOW)	WEIDMULLER	102002		WDU 2.5	VENDOR	
22	2	TERMINAL FEED THROUGH (RED)	WEIDMULLER	102004		WDU 2.5	VENDOR	
23	16	TERMINAL FEED THROUGH (ORANGE)	WEIDMULLER	102006		WDU 2.5	VENDOR	
24	22	TERMINAL FEED THROUGH (VIOLET)	WEIDMULLER	103770		WDU 2.5	VENDOR	
25	5	TERMINAL FEED THROUGH (GREEN)	WEIDMULLER	102009		WDU 2.5	VENDOR	
26	0	TERMINAL FEED THROUGH (BLUE)	WEIDMULLER	102008		WDU 2.5	VENDOR	
27	0	TERMINAL FEED THROUGH (WHITE)	WEIDMULLER	103660		WDU 2.5	VENDOR	
28	6	TERMINAL FEED THROUGH (POWER)	WEIDMULLER	102020		WDU 6	VENDOR	
29	14	TERMINAL FUSED c/w FUSE	WEIDMULLER	101220		WSI 6LD	VENDOR	
30	37	TERMINAL DISCONNECT (RED)	WEIDMULLER	101114		WTR 2.5	VENDOR	
31	1	TERMINAL DISCONNECT (ORANGE)	WEIDMULLER	101116		WTR 2.5	VENDOR	
32	6	TERMINAL DISCONNECT (BLUE)	WEIDMULLER	101118		WTR 2.5	VENDOR	
33	0	FUSE HOLDER c/w B.F.I.	WEIDMULLER	95375600		SIHA 1/G20/LD	VENDOR	
34	0	TERMINAL NON INCENDIVE (ANALOG)	WEIDMULLER	991808		MC6	VENDOR	
35	2	TERMINAL NON INCENDIVE (DISCRETE)	WEIDMULLER	991829			VENDOR	
36	8	TERMINAL FEED THROUGH 2 HIGH	WEIDMULLER	1041600000		WDX 2.5N	VENDOR	
37	1	BULKHEAD PASSTHROUGH	GENERIC				KILOWATTS	
38	1	UTILITY BOX DIN RAIL MOUNT	WEIDMULLER	7914760000			VENDOR	
39	AS REQ'D	JUMPER COMB	WEIDMULLER			WQB	VENDOR	
40	8	RELAY	WEIDMULLER	7940004781		MRS	VENDOR	
41	1	BOX OF 5 FUSES (1A)	BUSSMAN	GDA001		5x20mm	VENDOR	
42	1	BOX OF 5 FUSES (5A)	BUSSMAN	GDA005		5x20mm	VENDOR	
43	1	BOX OF 5 FUSES (10A)	BUSSMAN	ABC 10		5x20mm	VENDOR	
44	10	DIODES (REVERSE BIAS)		1N4007		1 AMP	VENDOR	
45	1	GROUNDING STRIP (PANEL)					VENDOR	
46	2	GROUNDING STRIP (INSTRUMENT)					VENDOR	
47	1	GROUND LUG					VENDOR	
48	1	PUSHBUTTON (RED MUSHROOM)	ALLEN-BRADLEY	800T-N310		1NO/1NC	VENDOR	
49	1	MUSHROOM HEAD GUARD	ALLEN-BRADLEY	800T-FX6			VENDOR	
50	1	CONTACT BLOCK	ALLEN-BRADLEY	800T-XD2P			VENDOR	
51	1	RELAY	OMRON	MY4H-US		24VDC,NO/NC,3A	VENDOR	
52	1	SOCKET	OMRON	PYF14A-E			VENDOR	
53	1	TERMINAL FUSED	WEIDMULLER	790169 0001		24VDC 10A	VENDOR	
54	AS REQ'D	WIREWAY & COVER	PANDUIT	WHITE		25x50	VENDOR	
55	AS REQ'D	WIREWAY & COVER	PANDUIT	WHITE		25x75	VENDOR	
56	AS REQ'D	WIREWAY & COVER	PANDUIT	GREY		25x75	VENDOR	
57	1	PANELVIEW COMM. CABLE	ACC	KILOWA01			KILOWATTS	
58	0	100 OHM 5 WATT RESISTOR					VENDOR	
59	1	COMMUNICATION CABLE	ALLEN-BRADLEY	1761-CBL-PM02			KILOWATTS	
60	0	PANELVIEW SELECTOR SWITCH	ALLEN-BRADLEY	800T-H178R			VENDOR	
61	1	PUSHBUTTON	ALLEN-BRADLEY	800T-A2D1P			VENDOR	


WARNING
ALL EQUIPMENT INSTALLED IN THIS PANEL MUST BE SUITABLE FOR USE IN A CLASS 1 DIVISION 2 LOCATION.
ALL FUSES MUST BE PORCELAIN OR SAND FILLED.
ENSURE THERE IS NO GAS PRESENT & POWER HAS BEEN REMOVED BEFORE OPERATING DISCONNECT TERMINALS OR SERVICING.

WARNING NAMEPLATE

MODEL: JRO 10M S/N: S400-06-03
V: 24VDC Hz: A: B:
CLASS 1 DIV 2/ZONE 2, CD

BACKPAN NAMEPLATE

KOBELCO K323LLNB.
- H2S - L.E.L. F2RB GYB.
- H2CH DESUH. 3 RBYL/B
- LOW SUCT.
- BACK PRESSURE VALVES
- SUCTION
- GOVERNOR
- AUTO LOAD
- SALBS GAS TEMP.
- 24V. GEN SET.
FUEL PANEL + LIGHTS



ITEM	QTY	DESCRIPTION	MANUFACTURER	CATALOG No.	SIZE	SUPPLIER
1	1	ENCLOSURE	HOFFMAN	CSD242410	610x610x254	VENDOR
2	0	PANELVIEW 300 (24VDC)	ALLEN-BRADLEY	2711-K3A5L1		KILOWATTS
3	0	24VDC POWER SUPPLY	ALLEN-BRADLEY	1769-PB2		KILOWATTS
4	1	MICROLOGIX PROCESSOR	ALLEN-BRADLEY	1764-LRP		KILOWATTS
5	1	PANELVIEW 1000 (24VDC)	ALLEN-BRADLEY	2711-T10C9L1		KILOWATTS
6	1	MICROLOGIX (24VDC)	ALLEN-BRADLEY	1764-288XB		KILOWATTS
7	0	ANALOG INPUT MODULE	ALLEN-BRADLEY	1769-IF4	4 PT.	KILOWATTS
8	3	ANALOG INPUT MODULE	ALLEN-BRADLEY	1769SC-IFB1	8 PT.	KILOWATTS
9	1	ANALOG OUTPUT MODULE	ALLEN-BRADLEY	1769-OF4C1	4 PT.	KILOWATTS
10	1	ANALOG OUTPUT MODULE	ALLEN-BRADLEY	1769-OF2	2 PT.	KILOWATTS
11	1	COMPACT I/O END CAP (RIGHT)	ALLEN-BRADLEY	1769-ECR		KILOWATTS
12	0	THERMOCOUPLE INPUT MODULE	ALLEN-BRADLEY	1769-IT6	6 PT.	KILOWATTS
13	0	ETHERNET MODULE	ALLEN-BRADLEY	1761-NET-EN1		KILOWATTS
14	1	SPEED TRANSMITTER	ACROMAG	250T-F01-DIN-DT1		KILOWATTS
15	1	KIT OF (4) MOUNTING FEET	HOFFMAN	62490 CMFK		VENDOR
16	AS REQ'D	TERMINAL MOUNTING RAIL	WEIDMULLER	23640	TS 35	VENDOR
17	AS REQ'D	LABEL DESCRIPTION HOLDER	WEIDMULLER	28246	SCHT-5S	VENDOR
18	AS REQ'D	TERMINAL END BRACKET	WEIDMULLER	36356	EW35	VENDOR
19	AS REQ'D	TERMINAL END SECTION	WEIDMULLER	105000	WAP 2.5-10	VENDOR
20	2	TERMINAL FEED THROUGH (GENERIC)	WEIDMULLER	102000	WDU 2.5	VENDOR
21	26	TERMINAL FEED THROUGH (YELLOW)	WEIDMULLER	102002	WDU 2.5	VENDOR
22	2	TERMINAL FEED THROUGH (RED)	WEIDMULLER	102004	WDU 2.5	VENDOR
23	16	TERMINAL FEED THROUGH (ORANGE)	WEIDMULLER	102006	WDU 2.5	VENDOR
24	22	TERMINAL FEED THROUGH (VIOLET)	WEIDMULLER	103770	WDU 2.5	VENDOR
25	5	TERMINAL FEED THROUGH (GREEN)	WEIDMULLER	102009	WDU 2.5	VENDOR
26	0	TERMINAL FEED THROUGH (BLUE)	WEIDMULLER	102008	WDU 2.5	VENDOR
27	0	TERMINAL FEED THROUGH (WHITE)	WEIDMULLER	103660	WDU 2.5	VENDOR
28	6	TERMINAL FEED THROUGH (POWER)	WEIDMULLER	102020	WDU 6	VENDOR
29	14	TERMINAL FUSED c/w FUSE	WEIDMULLER	101220	WSI 6LD	VENDOR
30	37	TERMINAL DISCONNECT (RED)	WEIDMULLER	101114	WTR 2.5	VENDOR
31	1	TERMINAL DISCONNECT (ORANGE)	WEIDMULLER	101116	WTR 2.5	VENDOR
32	6	TERMINAL DISCONNECT (BLUE)	WEIDMULLER	101118	WTR 2.5	VENDOR
33	0	FUSE HOLDER c/w B.F.I.	WEIDMULLER	95375600	SIHA 1/G20/LD	VENDOR
34	0	TERMINAL NON INCENDIVE (ANALOG)	WEIDMULLER	991808	MC6	VENDOR
35	2	TERMINAL NON INCENDIVE (DISCRETE)	WEIDMULLER	991829		VENDOR
36	8	TERMINAL FEED THROUGH 2 HIGH	WEIDMULLER	1041600000	WDX 2.5N	VENDOR
37	1	BULKHEAD PASSTHROUGH	GENERIC			KILOWATTS
38	1	UTILITY BOX DIN RAIL MOUNT	WEIDMULLER	7914760000		VENDOR
39	AS REQ'D	JUMPER COMB	WEIDMULLER		WQB	VENDOR
40	8	RELAY	WEIDMULLER	7940004781	MRS	VENDOR
41	1	BOX OF 5 FUSES (1A)	BUSSMAN	GDA001	5x20mm	VENDOR
42	1	BOX OF 5 FUSES (5A)	BUSSMAN	GDA005	5x20mm	VENDOR
43	1	BOX OF 5 FUSES (10A)	BUSSMAN	ABC 10	5x20mm	VENDOR
44	10	DIODES (REVERSE BIAS)		1N4007	1 AMP	VENDOR
45	1	GROUNDING STRIP (PANEL)				VENDOR
46	2	GROUNDING STRIP (INSTRUMENT)				VENDOR
47	1	GROUND LUG				VENDOR
48	1	PUSHBUTTON (RED MUSHROOM)	ALLEN-BRADLEY	800T-N310	1NO/1NC	VENDOR
49	1	MUSHROOM HEAD GUARD	ALLEN-BRADLEY	800T-FX6		VENDOR
50	1	CONTACT BLOCK	ALLEN-BRADLEY	800T-XD2P		VENDOR
51	1	RELAY	OMRON	MY4H-US	24VDC,NO/NC,3A	VENDOR
52	1	SOCKET	OMRON	PYF14A-E		VENDOR
53	1	TERMINAL FUSED	WEIDMULLER	790169 0001	24VDC 10A	VENDOR
54	AS REQ'D	WIREWAY & COVER	PANDUIT	WHITE	25x50	VENDOR
55	AS REQ'D	WIREWAY & COVER	PANDUIT	WHITE	25x75	VENDOR
56	AS REQ'D	WIREWAY & COVER	PANDUIT	GREY	25x75	VENDOR
57	1	PANELVIEW COMM. CABLE	ACC	KILOWA01		KILOWATTS
58	0	100 OHM 5 WATT RESISTOR				VENDOR
59	1	COMMUNICATION CABLE	ALLEN-BRADLEY	1761-CBL-PM02		KILOWATTS
60	0	PANELVIEW SELECTOR SWITCH	ALLEN-BRADLEY	800T-H178R		VENDOR
61	1	PUSHBUTTON	ALLEN-BRADLEY	800T-A2D1P		VENDOR

- NOTES**
- TERMINAL STRIPS TO BE RAISED UP OFF THE BACK PAN BY STEEL SECTION TO ALLOW FOR EASE OF ACCESS TO TERMINALS.
 - 24VDC WIRING INSIDE PANEL AS FOLLOWS:
- ALL 24VDC 'HOT' WIRING SHALL BE RED.
- ALL 24VDC 'LOGIC' WIRING SHALL BE ORANGE.
- ALL 24VDC 'NEUTRAL' WIRING SHALL BE YELLOW.
 - ANALOG WIRING SHALL BE VIOLET.
THERMOCOUPLE WIRING SHALL BE YELLOW/RED.
 - ALL WIRING SHALL BE TINNED COPPER #16AWG TEW.
 - CONTROL PANEL TO BE CSA APPROVED AND LABELED FOR CLASS 1, DIVISION 2, GROUP C & D HAZARDOUS AREA.
 - SHIP LOOSE VIBRATION MOUNTS.
 - CENTER OF PANEL VIEW MUST BE MOUNTED AT 1650mm ABOVE FLOOR BY FABRICATION SHOP PERSONEL.

NAMEPLATE SCHEDULE				
ITEM	QTY	COLOUR	ENGRAVING DESCRIPTION	SIZE
A	1	WHITE ON RED	EMERGENCY STOP	25x75
B	1	BLACK ON WHITE	SPARE FUSES/DIODES	17x35
C	1	BLACK ON WHITE	PANEL GROUND	25x75
D	2	BLACK ON WHITE	INSTRUMENT GROUND	25x75
E	1	WHITE ON RED	WARNING / MORE THAN ONE POWER SUPPLY	25x75
F	1	WHITE ON RED		25x75
G	1	BLACK ON WHITE	24V RESET	25x75
H				
J				
K				
L				
M				



NOTES:

- DISCRETE INPUTS ARE NON-INCENDIVE.

Project No.	No.	Revision	By	Date	Chk.	App.
2006-204	1	ADD 1769-OF2 MODULE	VL	07.01.22		
2006-204	A	ISSUED FOR APPROVAL	BM	06.04.28		

Prepared By:

Prepared For:
 EFX JRO JOB No: S400-06-03
 DRIVER: WAUKESHA F18G
 RATED RPM:

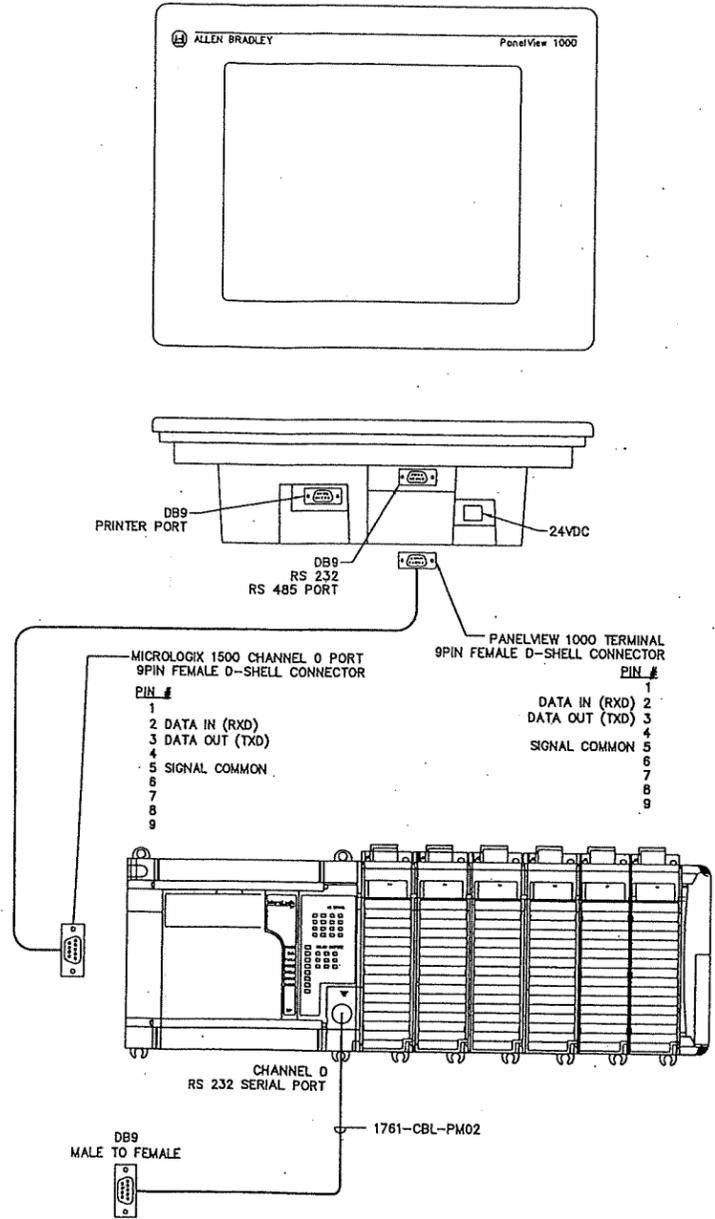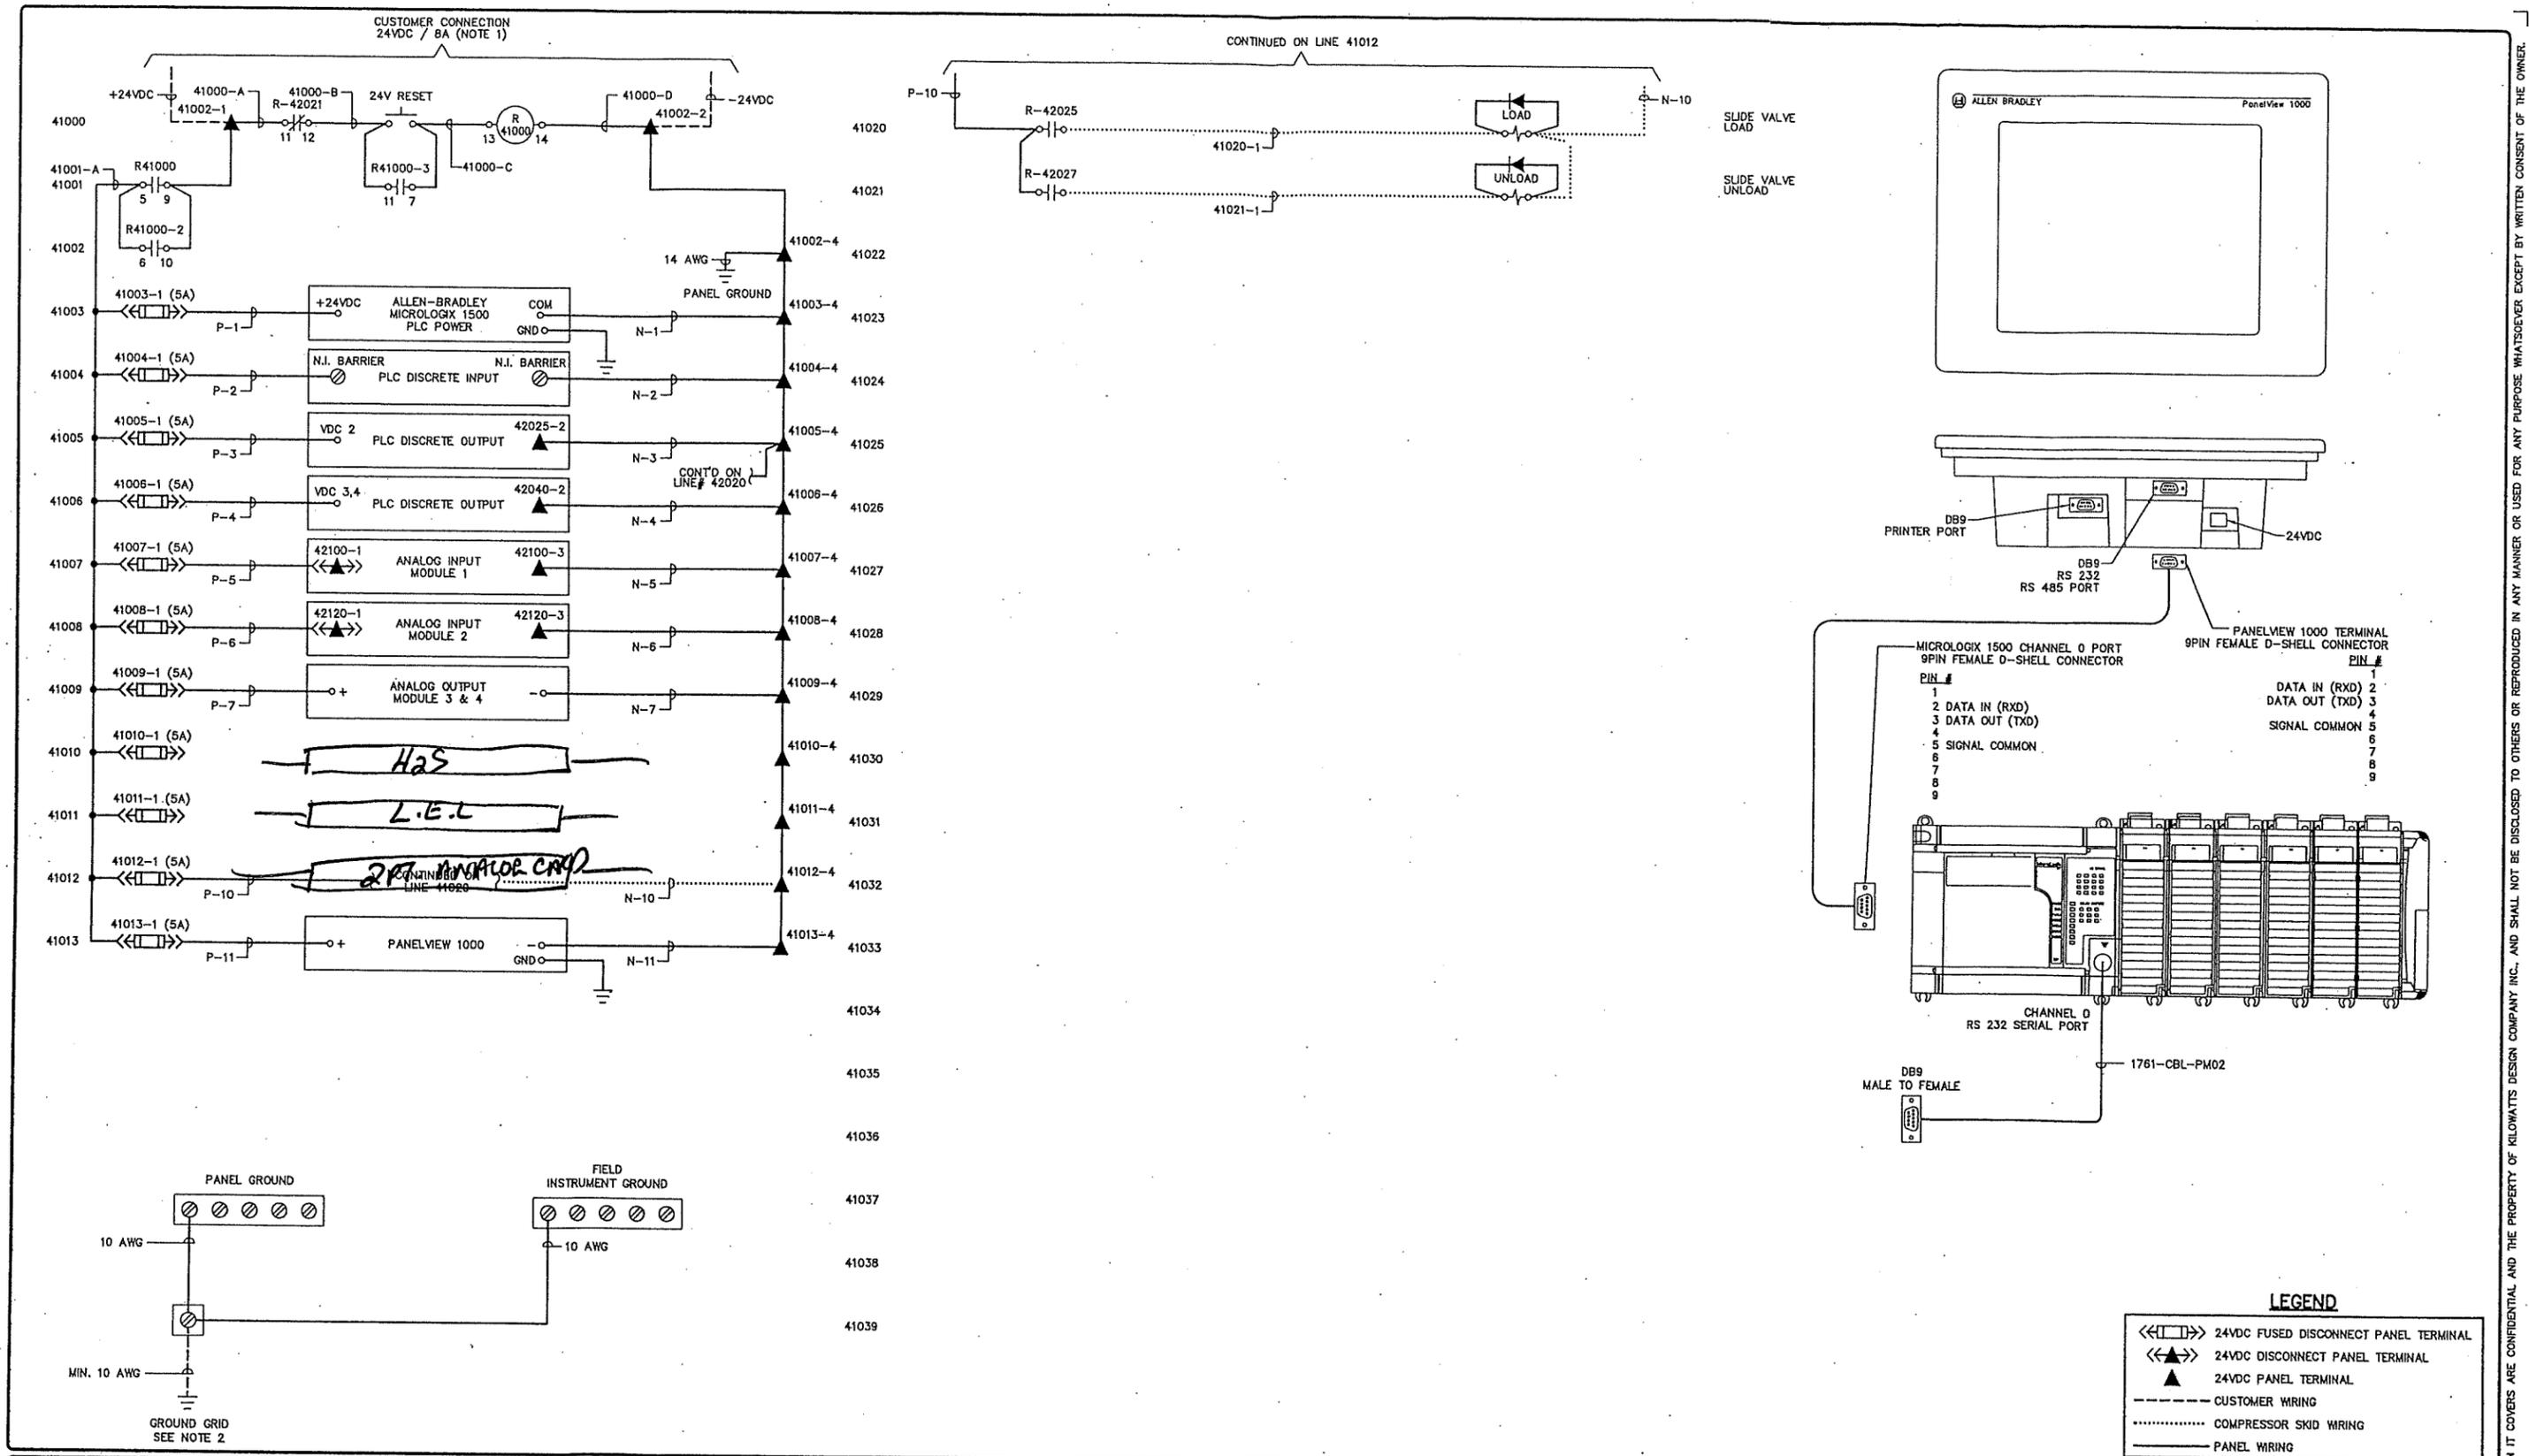

NOTES:

- PLEASE ALLOW FOR NO MORE THAN 3% VOLTAGE DROP WHEN SIZING CABLES.
- CUSTOMER TO CONNECT PANEL GROUND AND IGNITION SYSTEM GROUND TO SKID GROUND.

Project No.	No.	Revision	By	Date	Chk.	App.
2006-204	1	ADD 1769-0F2 MODULE	VL	07.01.22		
2006-204	A	ISSUED FOR APPROVAL	BM	06.04.28		

Prepared By:

Prepared For:

EFX JIRO JOB No: S400-06-03
 DRIVER: WAUKESHA F18GL
 RATED RPM: 1800
 No. TEETH: —
 COMPRESSOR: KOBELCO 23LLNB
 STAGE: SCREW
 SERVICE: SWEET

ENERFLEX JIRO

JIRO 10M PANEL
24VDC POWER DISTRIBUTION & BLOCK DIAGRAM

Drawn By	Scale	Drawing Number	Rev.
B. MILDTRAG	N.T.S.	A1-ELC-2006204-410	1


THE SCALE SHOWN IS FOR A1 (D) SIZE ONLY

THIS DRAWING AND THE DESIGN IT COVERS ARE CONFIDENTIAL AND THE PROPERTY OF KILOWATTS DESIGN COMPANY INC. AND SHALL NOT BE DISCLOSED TO OTHERS OR REPRODUCED IN ANY MANNER OR USED FOR ANY PURPOSE WHATSOEVER EXCEPT BY WRITTEN CONSENT OF THE OWNER.

41100
41101
41102
41103
41104
41105
41106
41107
41108
41109
41110
41111
41112
41113
41114
41115
41116
41117
41118
41119

41120
41121
41122
41123
41124
41125
41126
41127
41128
41129
41130
41131
41132
41133
41134
41135
41136
41137
41138
41139

WAUKESHA CEC IGNITION

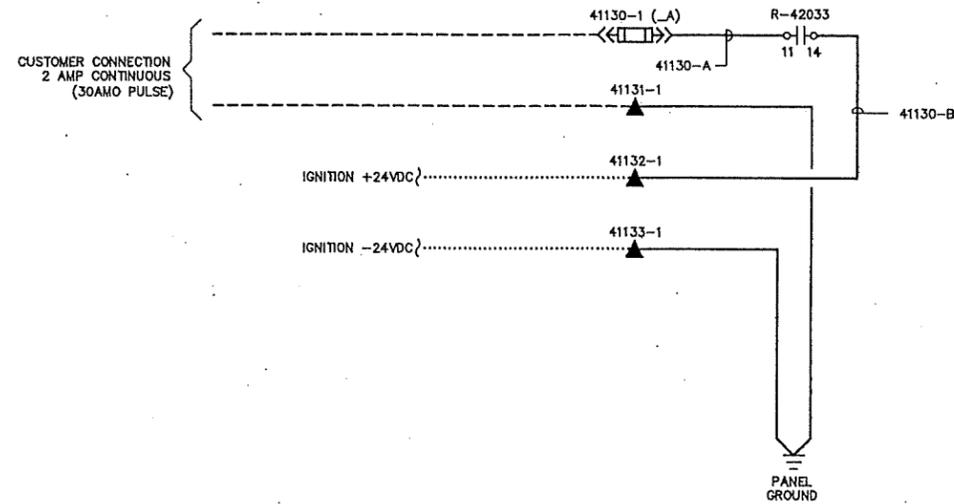

LEGEND

	24VDC FUSED DISCONNECT PANEL TERMINAL
	24VDC DISCONNECT PANEL TERMINAL
	24VDC PANEL TERMINAL
	CUSTOMER WIRING
	COMPRESSOR SKID WIRING
	PANEL WIRING

Project No.	No.	Revision	By	Date	Chk.	App.
2006-204	1	ADD 1769-DF2 MODULE	VL	07.01.22		
2006-204	A	ISSUED FOR APPROVAL	BM	06.04.28		

Prepared By:



KILOWATTS
DESIGN COMPANY INC.

Prepared For:




EFX JIRO JOB No:- S400-06-03
DRIVER: - WAUKESHA F18GL
RATED RPM: - 1800
No. TEETH: -
COMPRESSOR: - KOBELCO 23LLNB
STAGE: - SCREW
SERVICE: - SWEET

ENERFLEX JIRO

JIRO 10M PANEL
IGNITION SCHEMATIC

Drawn By	Scale	Drawing Number	Rev.
B. MILDRAG	N.T.S.	A1-ELC-2006204-411	1

THE SCALE SHOWN IS FOR A1 (0) SIZE ONLY

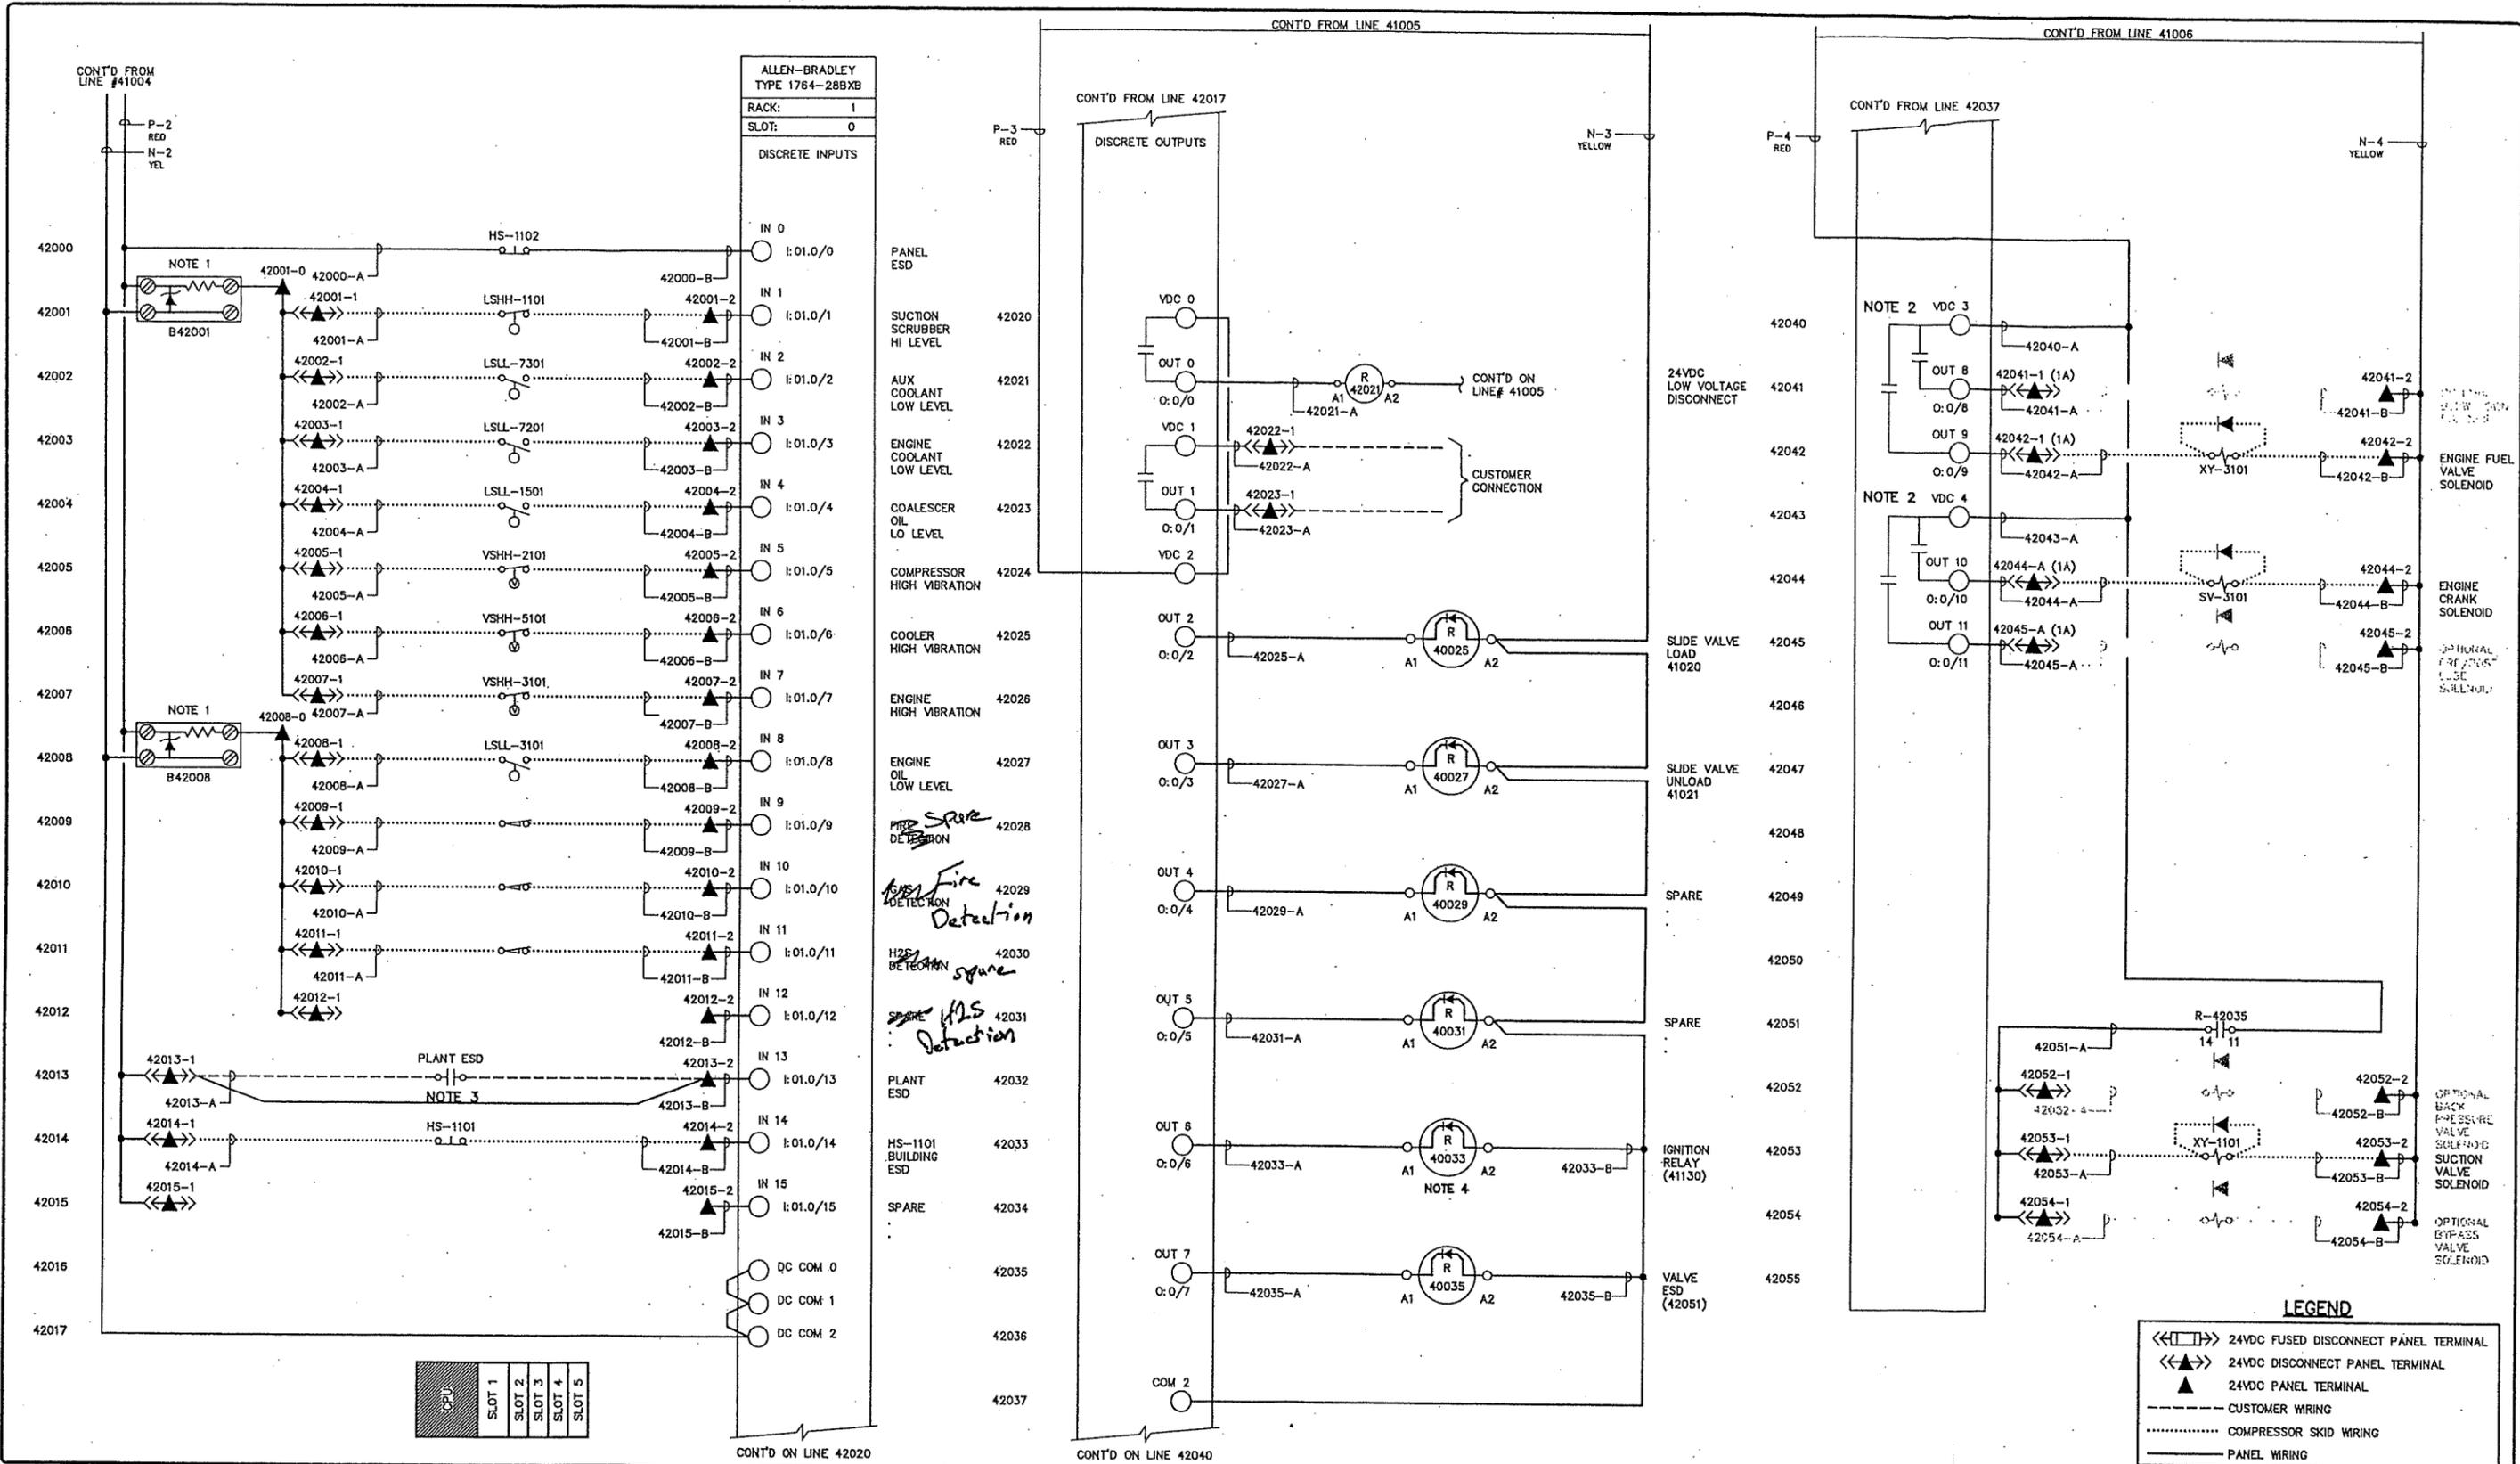

ALLEN-BRADLEY
TYPE 1764-28BXB
RACK: 1
SLOT: 0
DISCRETE INPUTS

IN 0	I:01.0/0	PANEL ESD
IN 1	I:01.0/1	SUCTION SCRUBBER HI LEVEL
IN 2	I:01.0/2	AUX COOLANT LOW LEVEL
IN 3	I:01.0/3	ENGINE COOLANT LOW LEVEL
IN 4	I:01.0/4	COALESCE OIL LO LEVEL
IN 5	I:01.0/5	COMPRESSOR HIGH VIBRATION
IN 6	I:01.0/6	COOLER HIGH VIBRATION
IN 7	I:01.0/7	ENGINE HIGH VIBRATION
IN 8	I:01.0/8	ENGINE OIL LOW LEVEL
IN 9	I:01.0/9	PHASE DETECTION
IN 10	I:01.0/10	WATER DETECTION
IN 11	I:01.0/11	H2S DETECTION
IN 12	I:01.0/12	SPARE H2S DETECTION
IN 13	I:01.0/13	PLANT ESD
IN 14	I:01.0/14	HS-1101 BUILDING ESD
IN 15	I:01.0/15	SPARE
DC COM 0		
DC COM 1		
DC COM 2		

42000	42001-0	42000-A
42001	42001-1	42001-B
42002	42002-1	42002-B
42003	42003-1	42003-B
42004	42004-1	42004-B
42005	42005-1	42005-B
42006	42006-1	42006-B
42007	42007-1	42007-B
42008	42008-1	42008-B
42009	42009-1	42009-B
42010	42010-1	42010-B
42011	42011-1	42011-B
42012	42012-1	42012-B
42013	42013-1	42013-B
42014	42014-1	42014-B
42015	42015-1	42015-B
42016		
42017		

OUT 0	O:0/0	VDC 0
OUT 1	O:0/1	VDC 1
OUT 2	O:0/2	VDC 2
OUT 3	O:0/3	VDC 3
OUT 4	O:0/4	VDC 4
OUT 5	O:0/5	VDC 5
OUT 6	O:0/6	VDC 6
OUT 7	O:0/7	VDC 7

42040	42040-A	42041-1 (1A)	42041-2
42041	42041-A	42041-B	42042-1 (1A)
42042	42042-A	42042-B	42043-A
42043	42043-A	42044-1 (1A)	42044-2
42044	42044-A	42044-B	42045-1 (1A)
42045	42045-A	42045-B	42051-A
42051	42051-A	42052-1	42052-2
42052	42052-A	42053-1	42053-2
42053	42053-A	42053-B	42054-1
42054	42054-A	42054-B	

CPU
SLOT 1
SLOT 2
SLOT 3
SLOT 4
SLOT 5

LEGEND

- ◀▶ 24VDC FUSED DISCONNECT PANEL TERMINAL
- ◀▶ 24VDC DISCONNECT PANEL TERMINAL
- ▲ 24VDC PANEL TERMINAL
- CUSTOMER WIRING
- COMPRESSOR SKID WIRING
- PANEL WIRING

NOTES:

- WEIDMULLER NON-INCENDIVE BARRIER CLASS 1, DIV 2 GR. A, B, C & D 35VDC MAX 75mA MAX LIMIT.
- MAXIMUM CONTINUOUS CURRENT 2.0 A AT 24 VDC.
- REMOVE JUMPER IF CUSTOMER PLANT ESD IS USED.
- IGNITION RELAY IS PHYSICALLY LOCATED WITHIN THE PANEL'S IGNITION SECTION (L) TERMINALS.

2006-204	1	ADD 1769-0F2 MODULE	VL	07.01.22
2006-204	A	ISSUED FOR APPROVAL	BM	06.04.28
Project No.	No.	Revision	By	Date

Prepared By:

Prepared For:

EFX JIRO JOB No: S400-06-03
 DRIVER: WAUKESHA F18GL
 RATED RPM: 1800
 No. TEETH: —
 COMPRESSOR: KOBELCO 23LLNB
 STAGE: — SCREW
 SERVICE: — SWEET




ENERFLEX JIRO

JIRO 10M PANEL
 CONTROL SCHEMATICS SLOT CPU


Drawn By	Scale	Drawing Number	Rev.
B. MILDRAO	N.T.S.	A1-ELC-2006204-420	1

THE SCALE SHOWN IS FOR A1 (D) SIZE ONLY

THIS DRAWING AND THE DESIGN IT COVERS ARE CONFIDENTIAL AND THE PROPERTY OF KILOWATTS DESIGN COMPANY INC. AND SHALL NOT BE DISCLOSED TO OTHERS OR REPRODUCED IN ANY MANNER OR USED FOR ANY PURPOSE WHATSOEVER EXCEPT BY WRITTEN CONSENT OF THE OWNER.

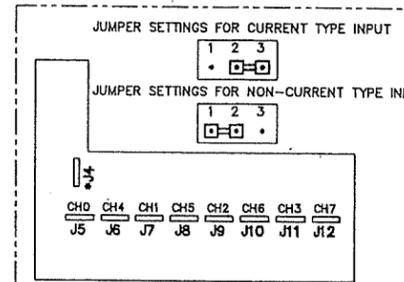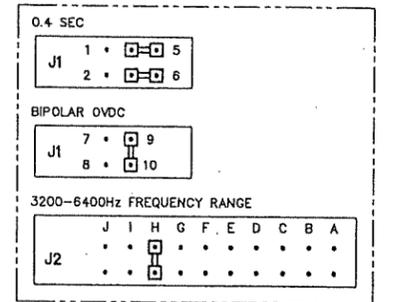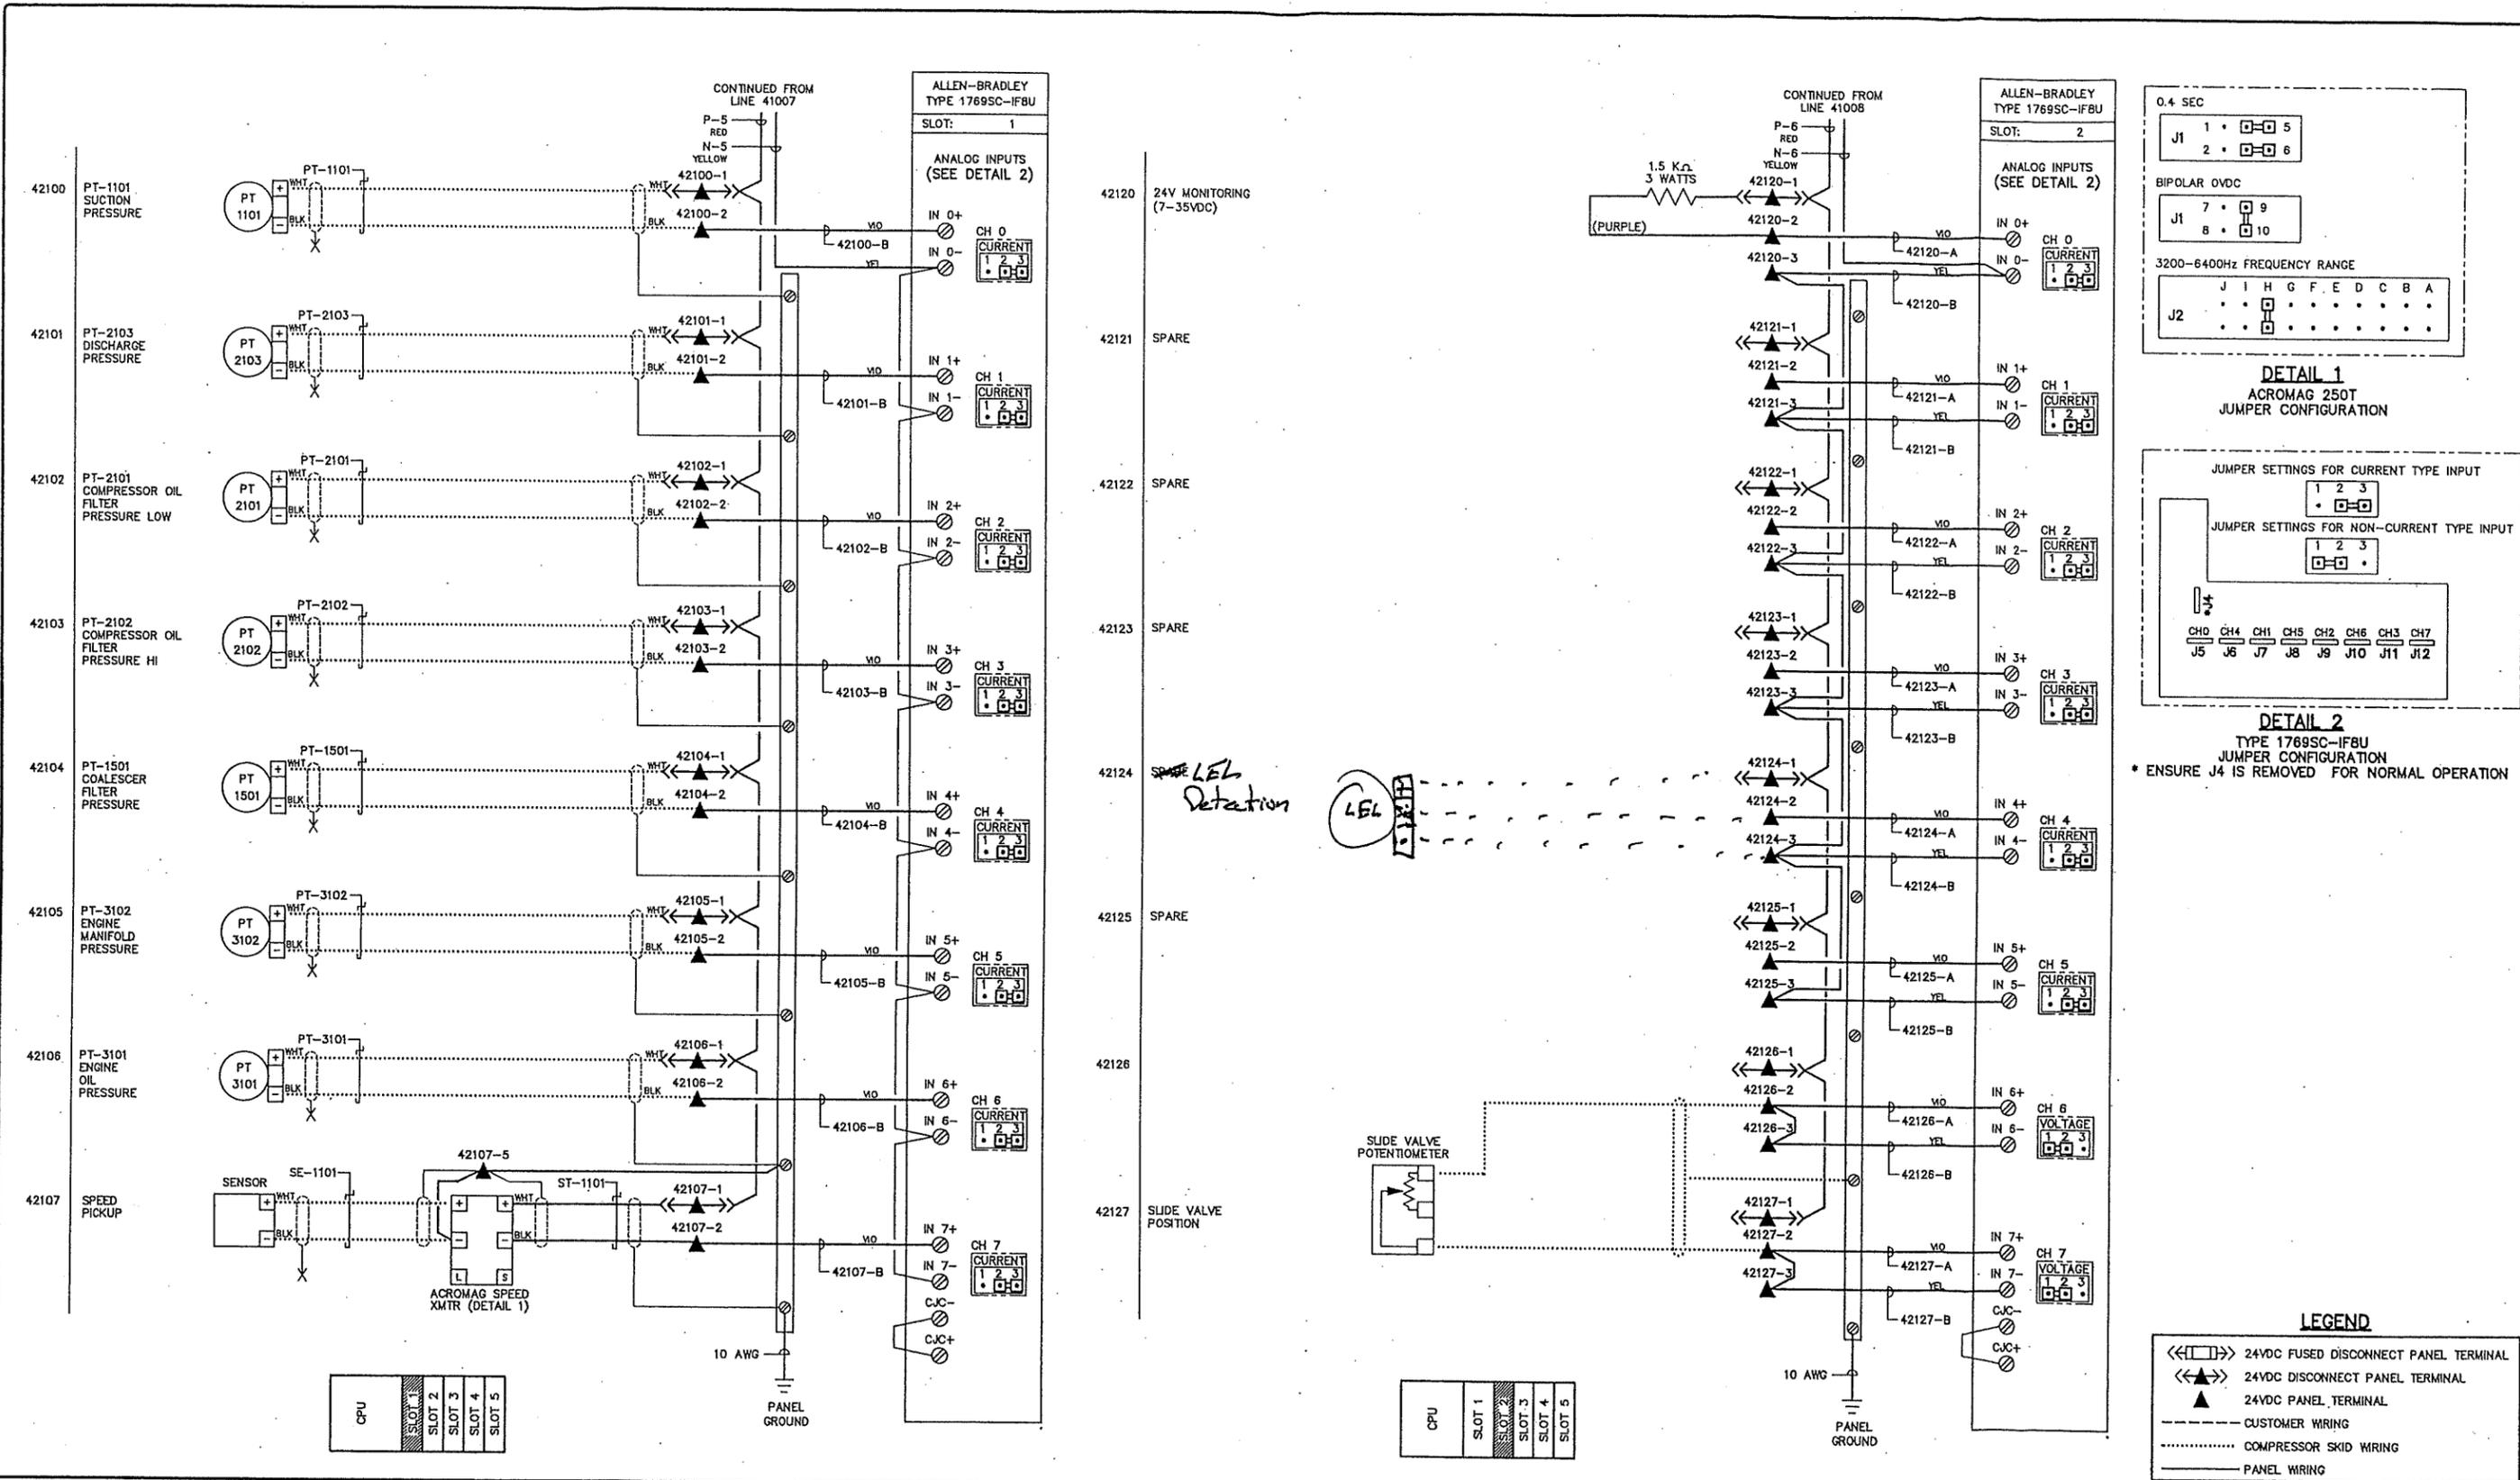

DETAIL 2
TYPE 1769SC-IF8U
JUMPER CONFIGURATION
* ENSURE J4 IS REMOVED FOR NORMAL OPERATION

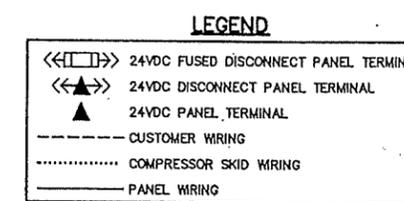

2006-204	1	ADD 1769-0F2 MODULE	VL	07.01.22		
2006-204	A	ISSUED FOR APPROVAL	BM	06.04.28		
Project No.	No.	Revision	By	Date	Chk.	App.

Prepared By:

Prepared For:

EFX JIRO JOB No: S400-06-03
 DRIVER: WAUKESHA F18GL
 RATED RPM: 1800
 No. TEETH: -
 COMPRESSOR: KOBELCO 23LLNB
 STAGE: -
 SERVICE: SCREW


ENERFLEX JIRO

JIRO 10M PANEL
CONTROL SCHEMATICS SLOT 1 & 2

Drawn By	Scale	Drawing Number	Rev.
B. MILDRAG	N.T.S.	A1-ELC-2006204-421	1

THE SCALE SHOWN IS FOR A1 (D) SIZE ONLY

THIS DRAWING AND THE DESIGN IT COVERS ARE CONFIDENTIAL AND THE PROPERTY OF KILOWATTS DESIGN COMPANY INC. AND SHALL NOT BE DISCLOSED TO OTHERS OR REPRODUCED IN ANY MANNER OR USED FOR ANY PURPOSE WHATSOEVER EXCEPT BY WRITTEN CONSENT OF THE OWNER.

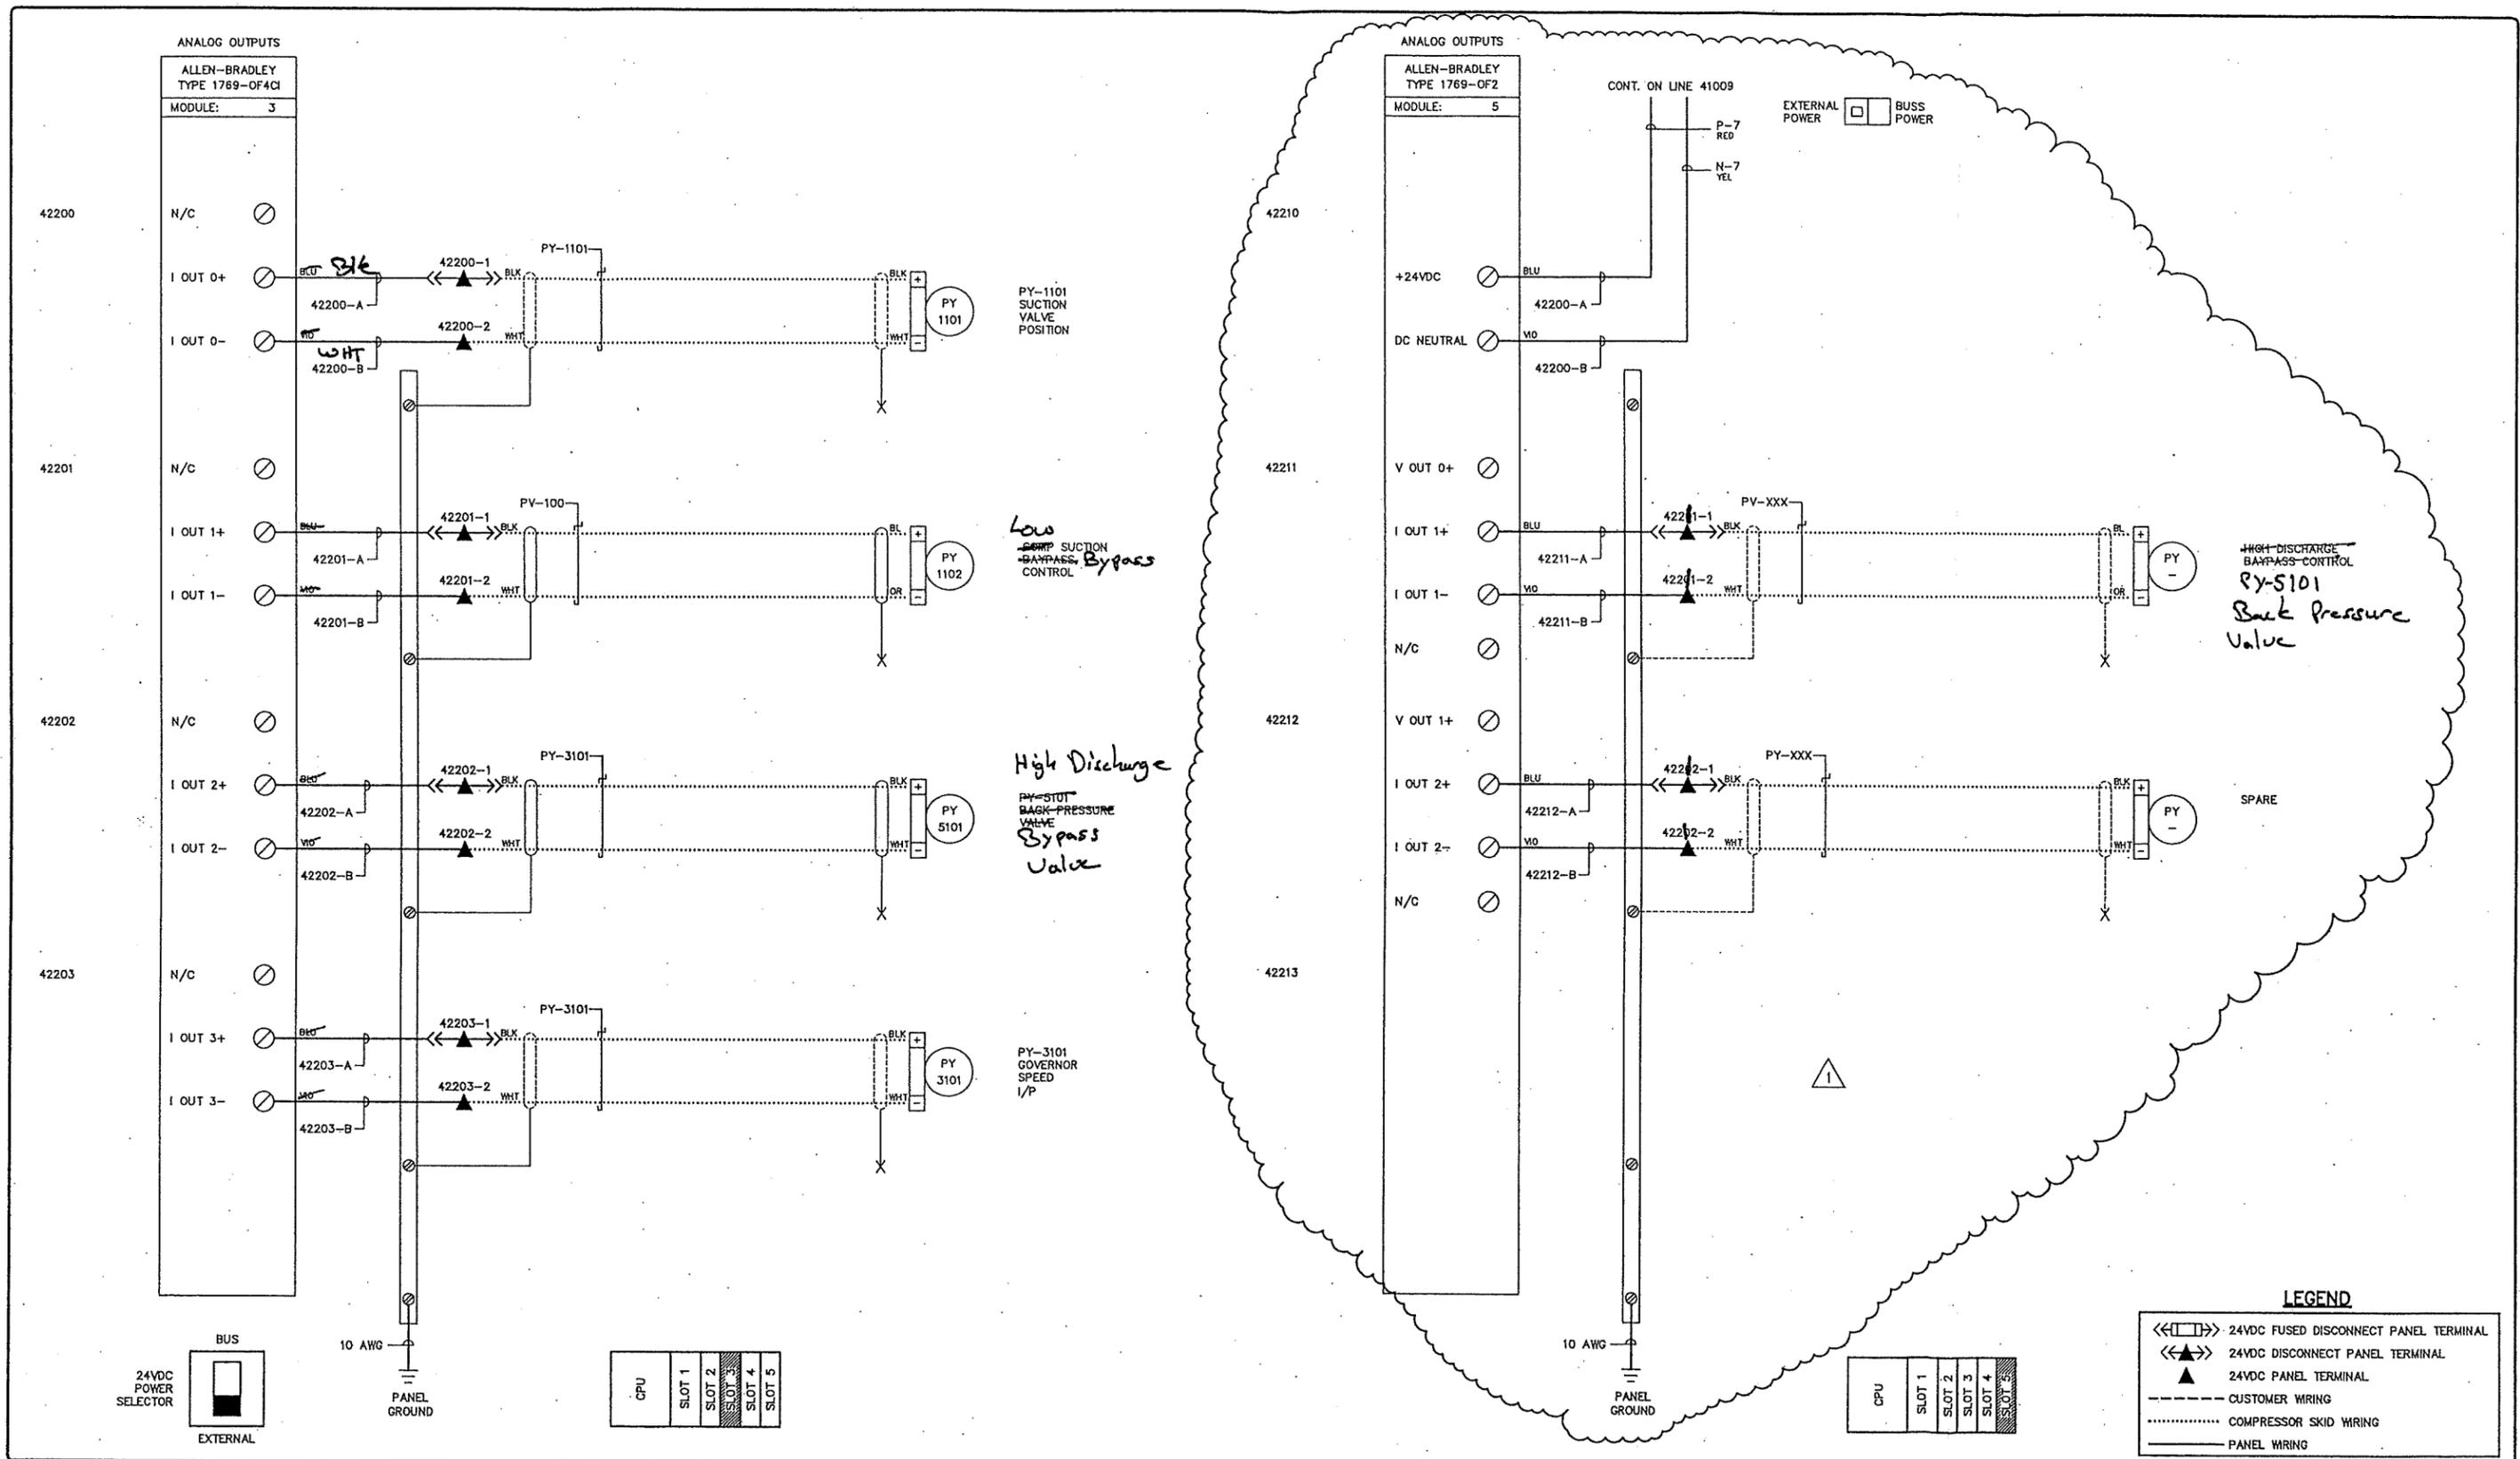

LEGEND

◁▷	24VDC FUSED DISCONNECT PANEL TERMINAL
◁▷	24VDC DISCONNECT PANEL TERMINAL
▲	24VDC PANEL TERMINAL
---	CUSTOMER WIRING
.....	COMPRESSOR SKID WIRING
—	PANEL WIRING

Project No.	No.	Revision	By	Date	Chk.	App.
2006-204	1	ADD 1769-0F2 MODULE	VL	07.01.22		
2006-204	A	ISSUED FOR APPROVAL	BM	06.04.28		

Prepared By:

Prepared For:

EFX JIRO JOB No: S400-06-03
 DRIVER: WAUKESHA F18GL
 RATED RPM: 1800
 No. TEETH: —
 COMPRESSOR: KOBELCO 23LLNB
 STAGE: SCREW
 SERVICE: SWEET

ENERFLEX JIRO



JIRO 10M PANEL
 CONTROL SCHEMATICS SLOT 3 & 5

Drawn By	Scale	Drawing Number	Rev.
B. MILDRAG	N.T.S.	A1-ELC-2006204-422	1


THE SCALE SHOWN IS FOR A1 (D) SIZE ONLY

THIS DRAWING AND THE DESIGN IT COVERS ARE CONFIDENTIAL AND THE PROPERTY OF KILOWATTS DESIGN COMPANY INC., AND SHALL NOT BE DISCLOSED TO OTHERS OR REPRODUCED IN ANY MANNER OR USED FOR ANY PURPOSE WHATSOEVER EXCEPT BY WRITTEN CONSENT OF THE OWNER.

THIS DRAWING AND THE DESIGN IT COVERS ARE CONFIDENTIAL AND THE PROPERTY OF KILOWATTS DESIGN COMPANY INC., AND SHALL NOT BE DISCLOSED TO OTHERS OR REPRODUCED IN ANY MANNER OR USED FOR ANY PURPOSE WHATSOEVER EXCEPT BY WRITTEN CONSENT OF THE OWNER.

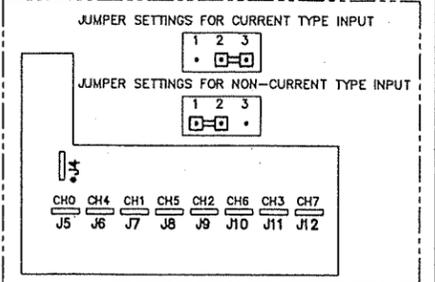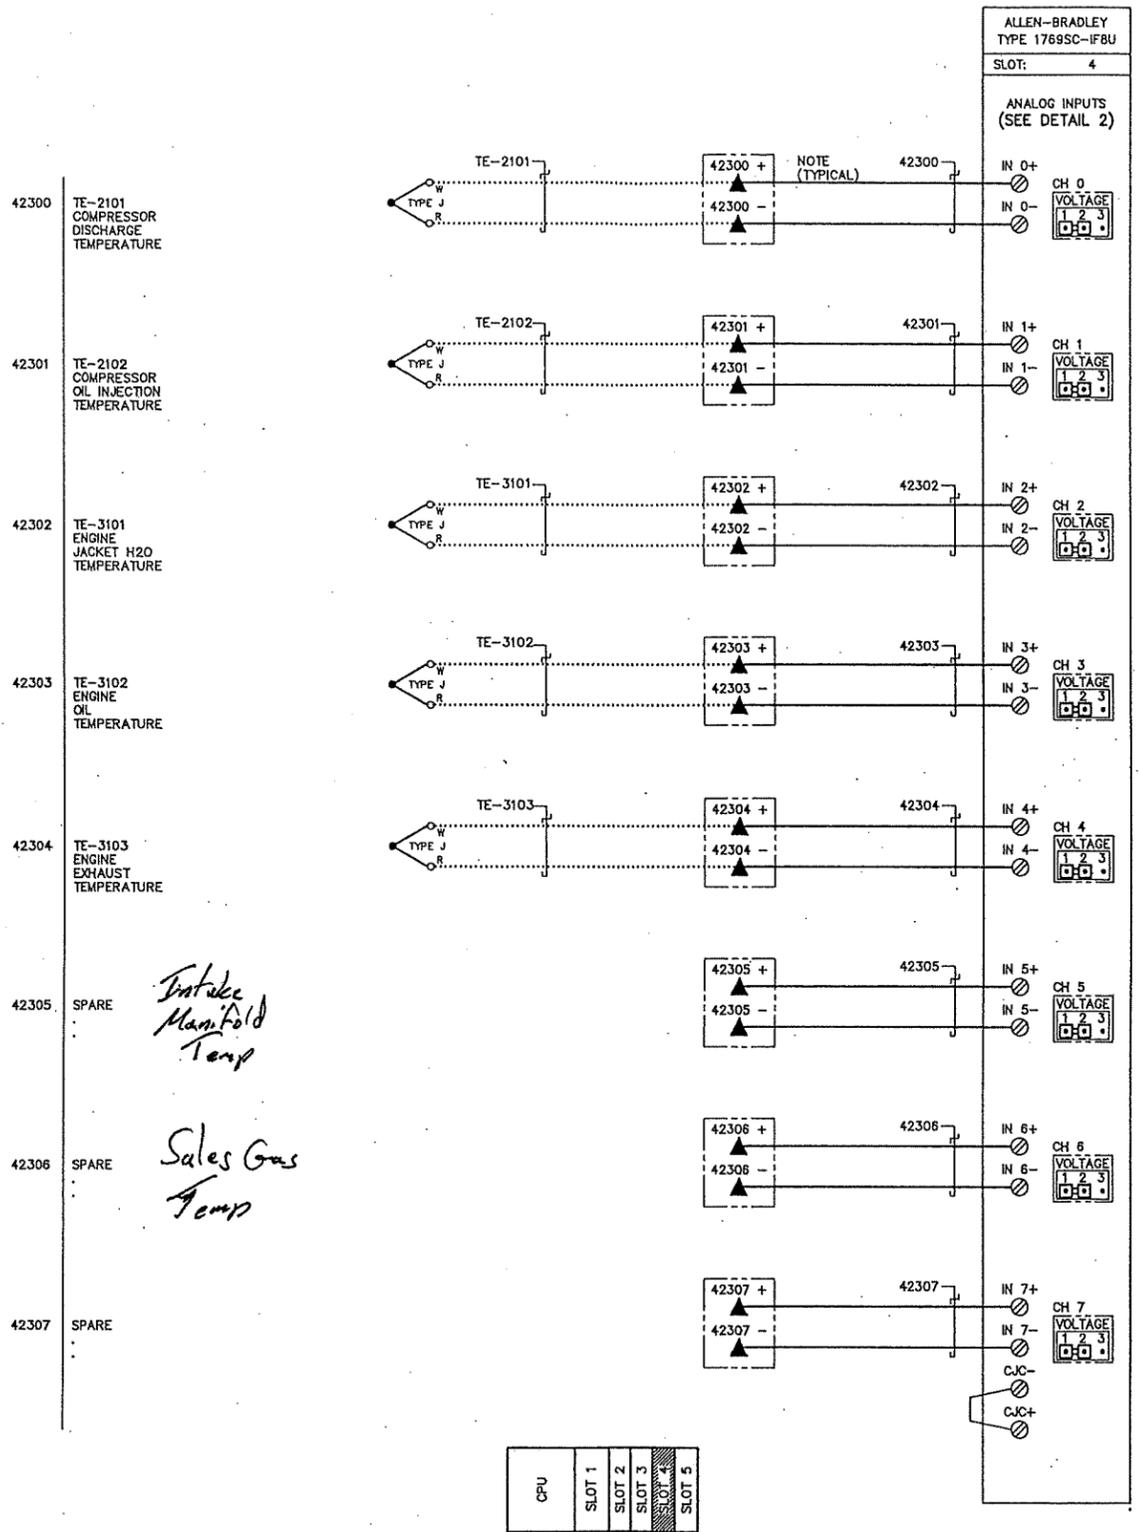

DETAIL 2
TYPE 1769SC-IF8U
JUMPER CONFIGURATION
* ENSURE J4 IS REMOVED FOR NORMAL OPERATION

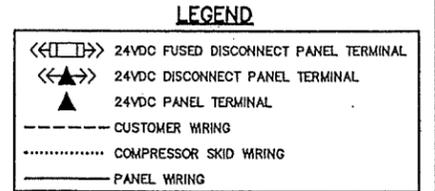

NOTE:
1. TYPE "J" THERMOCOUPLE WIRE.

Project No.	No.	Revision	By	Date	Chk.	App.
2006-204	1	ADD 1769-0F2 MODULE	VL	07.01.22		
2006-204	A	ISSUED FOR APPROVAL	BM	06.04.28		

Prepared By:

Prepared For:

EFX JIRO JOB No:- S400-06-03
DRIVER: - WAUKESHA F18GL
RATED RPM: - 1800
No. TEETH: -
COMPRESSOR: - KOBELCO 23LLNB
STAGE: - SCREW
SERVICE: - SWEET

ENERFLEX JIRO

JIRO 10M PANEL
CONTROL SCHEMATICS SLOT 4

Drawn By	Scale	Drawing Number	Rev.
B. MILDRAG	N.T.S.	A1-ELC-2006204-423	1

THE SCALE SHOWN IS FOR A1 (D) SIZE ONLY