




ADDITIONAL DUCTWORK
SEE DWG. 94-643-EC11

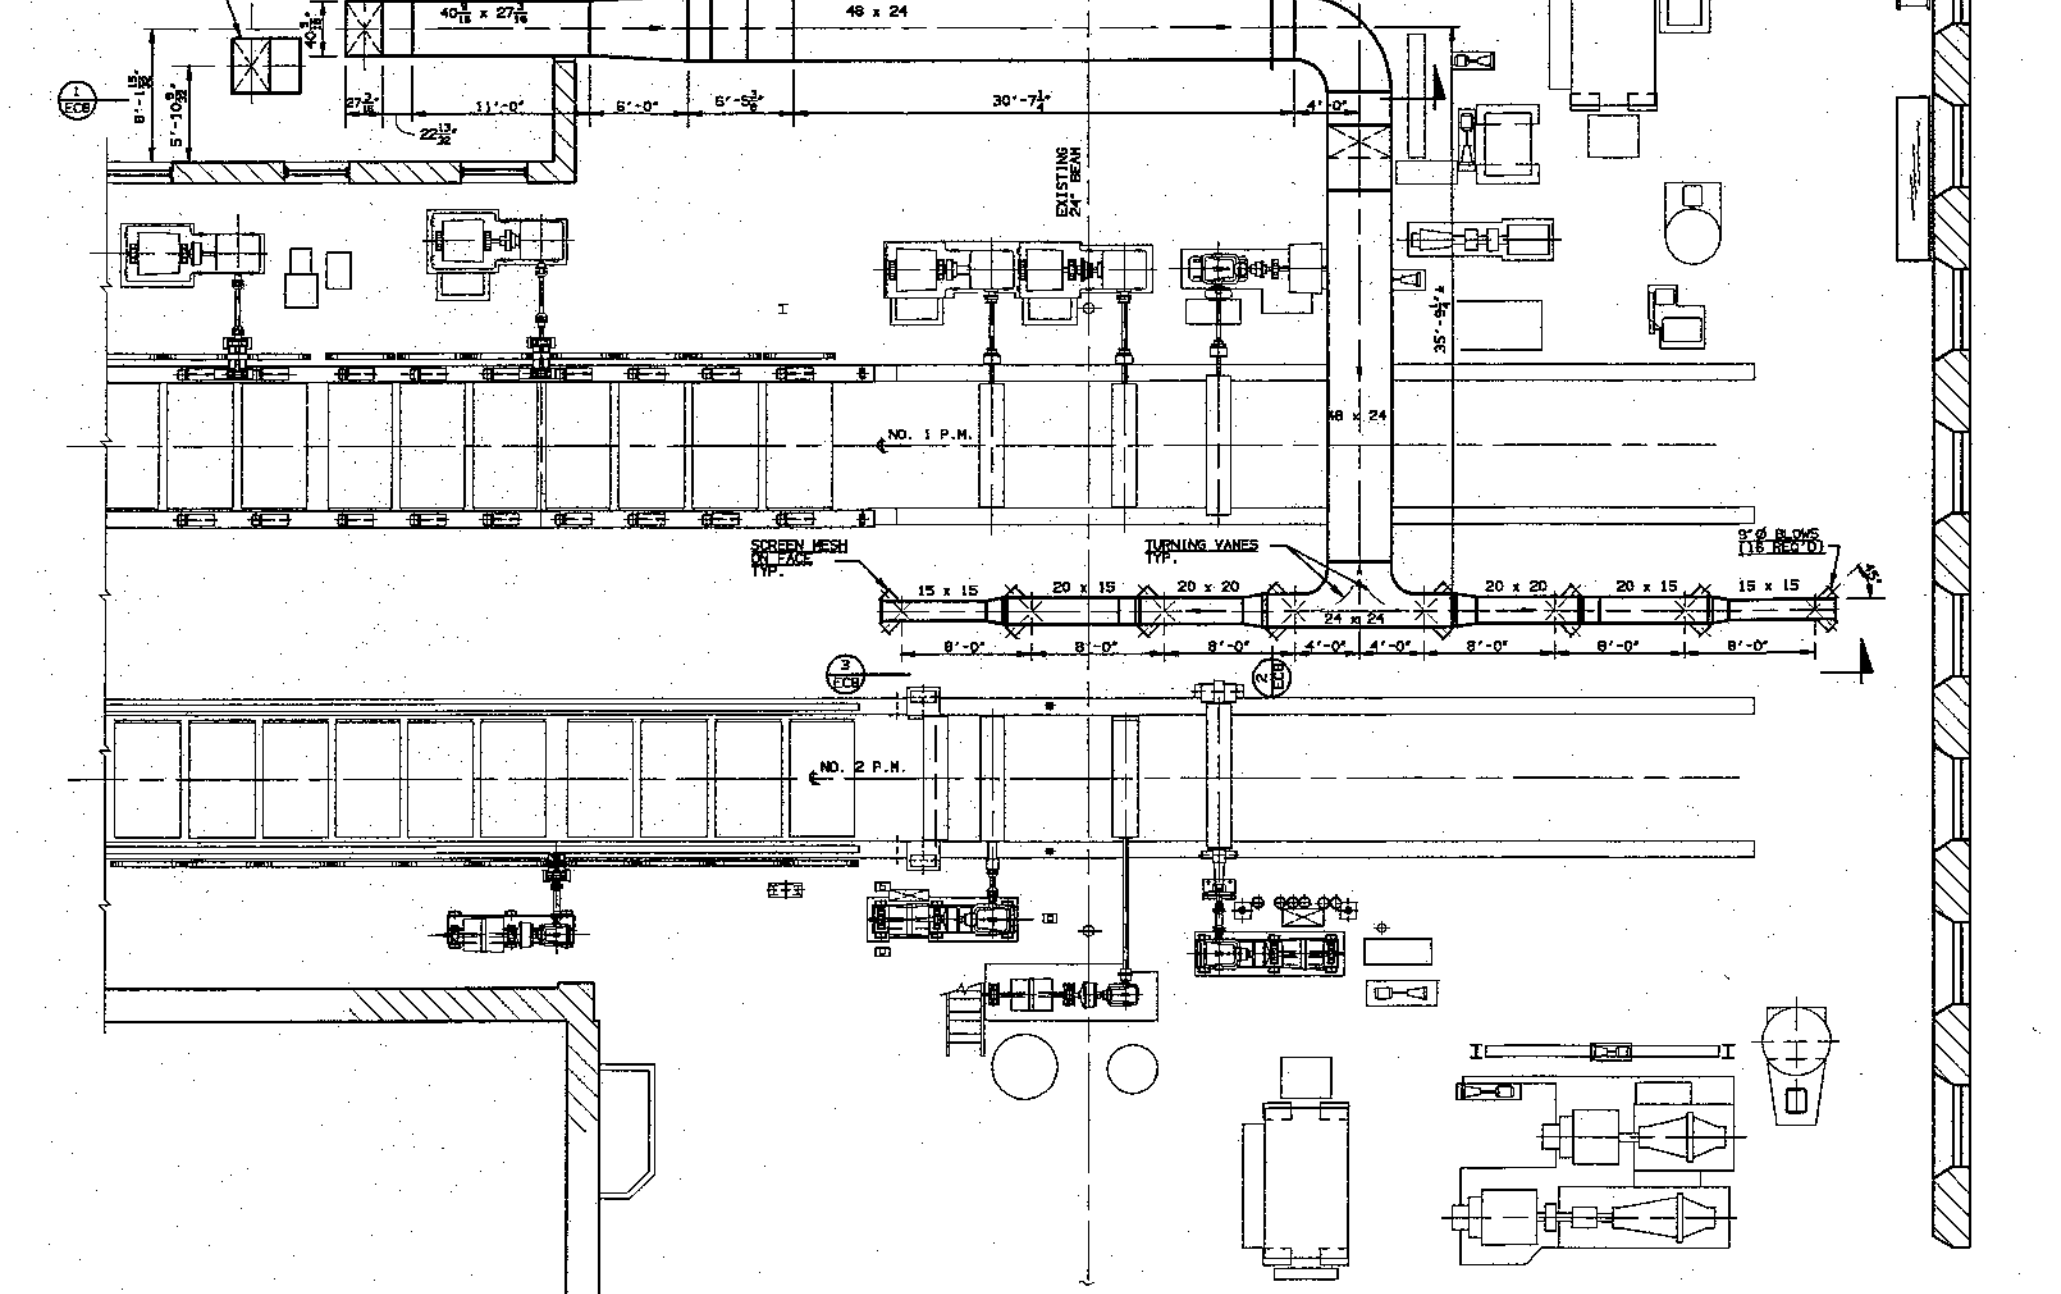

ECONOMISER - OPERATING FLOOR DUCT PLAN

3/16" = 1'-0"

GENERAL NOTES

1. ALL DIMENSIONS ARE PLUS OR MINUS AND SHALL BE FIELD VERIFIED PRIOR TO CONSTRUCTION AND INSTALLATION.
2. SEE DRAWING 99-643-HB FOR EXHAUST DUCT PLAN AND ELEVATION.
3. ALL WALL AND FLOORING THAT IS TO REMAIN AFTER INSTALLATION OF EQUIPMENT, DUCTING, ETC. SHALL BE PATCHED TO MATCH EXISTING MATERIAL.
4. ALL DUCTING TO BE ALUMINIUM, 18 GA. (.040) FOR DUCT UP TO 30". 16 GA. (.031) FOR DUCT ABOVE 31".
5. ALL DUCTING TO BE SUPPORTED ACCORDING TO STANDARD SPECIFICATIONS AND PROPERLY INSTALLED.
6. ALL MILD STEEL PARTS TO BE PRIMED AND PAINTED.
7. INSULATION ON BLOWER DISCHARGE TO EXTERIOR WALL CONNECTION TO BE 1" THICK RIGID WITH WEATHER PROOF COVERING ON ALL EXTERIOR DUCT.

POTASH-DELMOLINO-DAVIS INC. Industrial Design Services	
Dartmouth, Mass. 01226	
RISING PAPER COMPANY	
HOUSATONIC, MA 01236	
NO. 1 P.H. DRYER SECTION MODIFICATIONS	SCALE: AS NOTED DRAWN BY: MTK CHECKED BY: DPH/CFP
ECONOMISER - OPERATING FLOOR FAN DUCT PLAN	
DATE: 04-04-95	DATE: 10
DRAWING NUMBER: 94-643-EC7	

REV.	DESCRIPTION	DATE	BY