




ULTRASONIC REPORT

CLIENT INFO

CUSTOMER / CLIENT:	RARE (AT ASPIRE)	CLIENT JOB NO.:		REPORT NO. :	241002-UDJ-5
CONTRACTOR:	N/A	CLIENT CODING:		DATE:	2/Oct/24
PROJECT:	UT ON SPEARATOR AND ASSOCIATED HEADER	CLIENT APPROVER:	ROB GRYBA	TECHNICIAN:	DAVID JAMES
LOCATION / LSD:	22 Mckenzie Drive, Red Deer County, Alberta	ASSISTANT:			Blade Lustig

EXAMINATION & TEST RESULTS

TML #	DIA.	TYPE	NOM.	Nom - 12.5% Mill Tol.	UT Low	UT Avg	% Wall Loss
00	16.000	HEAD	0.811	-	0.871	0.893	-7.4%
05	16.000	SHELL	0.866	0.758	0.819	0.841	5.4%
10	16.000	SHELL	0.866	0.758	0.792	0.812	8.5%
15	16.000	SHELL	0.866	0.758	0.821	0.836	5.2%
20	16.000	HEAD	0.811	0.710	0.866	0.887	-6.8%
25	2.375	90° ELBOW N	0.343	0.300	0.335	0.357	2.3%
30	3.500	90° ELBOW	0.216	0.189	0.185	0.199	14.4%
35	2.375	90° ELBOW	0.218	0.191	0.19	0.207	12.8%
40	2.375	45° ELBOW	0.218	0.191	0.19	0.2	12.8%
45	3.500	0.216	0.216	0.189	0.191	0.201	11.6%
50	3.500	0.216	0.216	0.189	0.2	0.215	7.4%
55	3.500	0.216	0.216	0.189	0.212	0.221	1.9%
60	2.375	0.218	0.218	0.191	0.2	0.212	8.3%

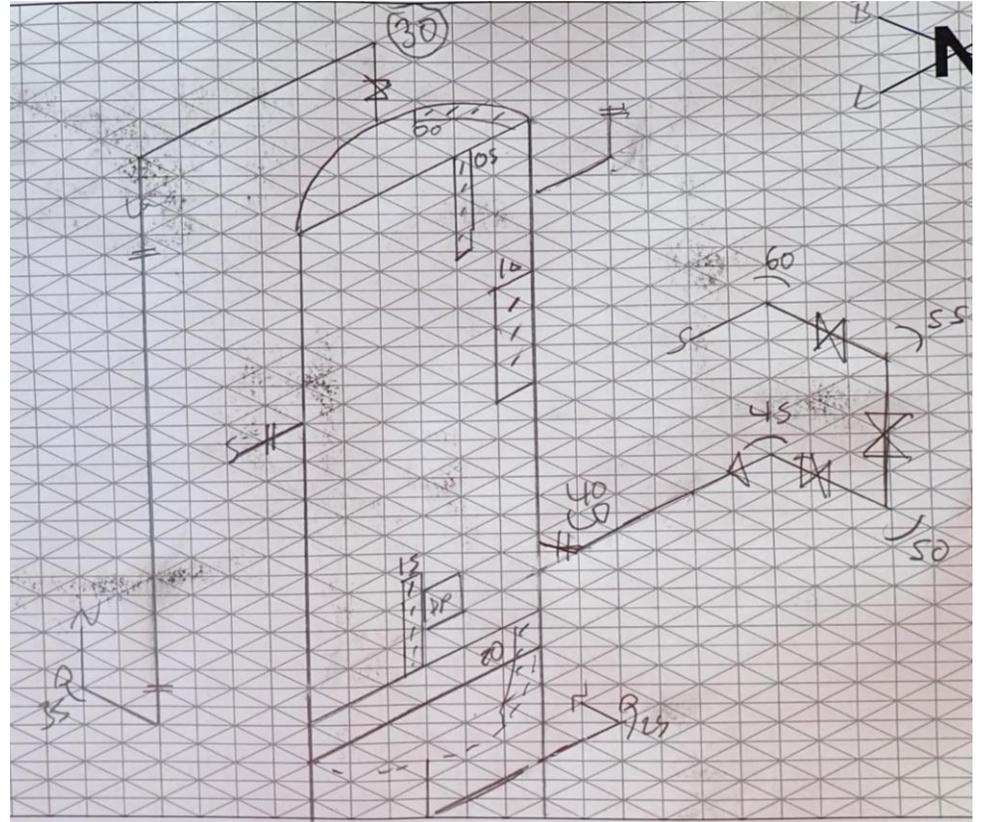

NOMINALS ASSUMED