
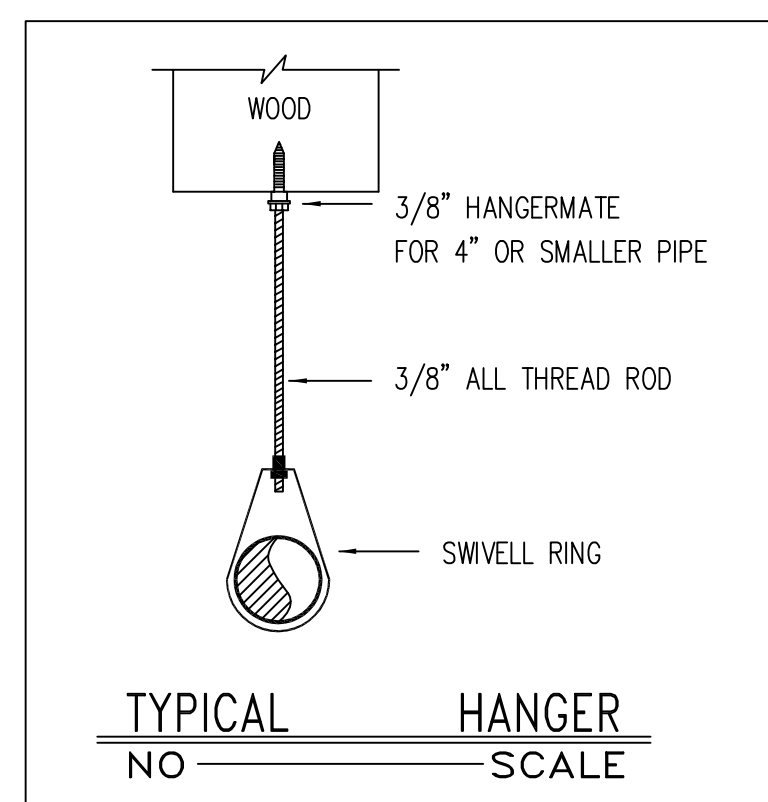


IMPORTANT!		
OWNERS MUST MAINTAIN SUFFICIENT HEAT (MINIMUM 54°F) THROUGHOUT THE AREAS WHERE "WET" SYSTEMS ARE INSTALLED TO PREVENT FREEZING OF WATER UNDER ANTI-FREEZE OR A DRY SYSTEM IS PROVIDED.		
12 in 	INDICATES THE DISTANCE IN INCHES OR MILLIMETERS FROM THE CENTER LINE OF THE PIPE TO THE UNDERSIDE OF THE CEILING, CONCRETE SLAB OR ROOF DECK.	HYDRAULIC REFERENCE POINT
4.0' 	INDICATES THE DISTANCE IN FEET OR MILLIMETERS FROM THE CENTER LINE OF THE PIPE TO THE FLOOR.	SPRINKLERS IN CENTER OF TILES NONE 1 WAY 2 WAYS
NOTES THIS DRAWING IS THE PROPERTY OF VIKING PIPE PROTECTION INC. AND IS INTENDED TO BE USED FOR PURPOSES OF THIS PROJECT. THE DISTRIBUTION OR REPRODUCTION IS PROHIBITED UNLESS EXPLICITLY AUTHORIZED.		

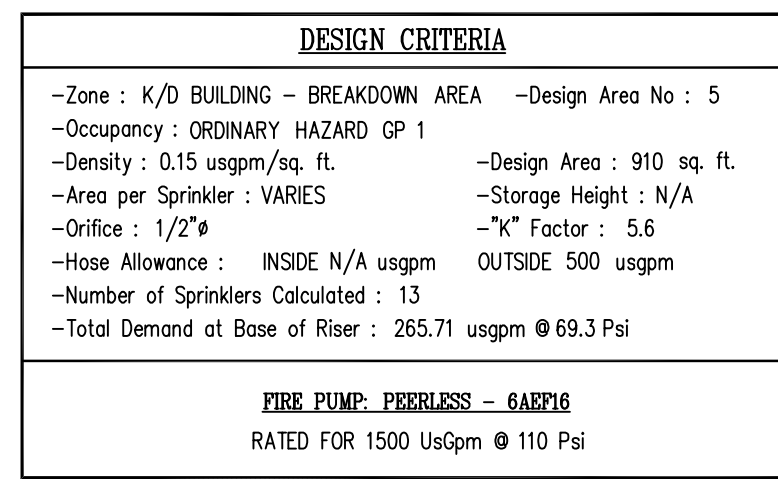

1. LINES TO BE SCH.10 BLK. PIPE (GRVD. ENDS) C/W SNAPLETS FOR HEADS & DROPS, JOINED WITH GROOVED FITTINGS
2. DROPS TO BE SCH.40 BLK. PIPE WITH BLK. C.I. SCRD. FITTINGS
3. MAINS TO BE SCH.10 BLK. PIPE (GRVD. ENDS) C/W MECH-TEES FOR LINES, JOINED WITH GROOVED FITTINGS

[illegible]