

API 510 PRESSURE VESSEL INSPECTION REPORT

GENERAL INFORMATION

CLIENT:	Tourmaline Oil Corporation	REPORT NUMBER:	
PROJECT:		INSPECTION DATE:	9/22/2025
FACILITY:	Septimus Compressor Station	APPLUS JOB NO.:	4051051
LOCATION / LSD:	09-36-81-19W6M	ORIENTATION:	☐ Horizontal ☒ Vertical
VESSEL NAME:	Glycol Flash Tank	STATUS:	☐ In-service ☒ Out of Service
EQUIPMENT NO.:	V-2270	INSPECTION TYPE:	☒ Regulatory ☐ Inventory ☒ VE ☐ VI

PRESSURE VESSEL NAMEPLATE DATA

PROV. REG. NO.:	A0516852		CRN NUMBER:	R8769.2	
SERIAL NUMBER:	2004-7269-07		SIZE:	12.75" x 60"	
MANUFACTURER:	ALCO GAS & OIL PRODUCTION EQUIP.		CODE PARAMETERS:	ASME VIII, Div. 1	
YEAR BUILT:	2004		MANWAY ACCESS:	NO	
RADIOGRAPHY:	RT-1		HEAT TREATMENT:	YES	
COATED:			CORR. ALLOWANCE:	0.125"	
SHELL THICKNESS:	0.375"		SHELL MATERIAL:	SA 108-B	
HEAD THICKNESS:	0.270"		HEAD MATERIAL:	SA 516-70N	
TUBE THICKNESS:			TUBE MATERIAL:		
TUBE DIAMETER:			TUBE LENGTH:		
DESIGN PRESSURE:	SHELL:	250 PSI	OPERATING PRESSURE:	SHELL:	
	TUBES:			TUBES:	
DESIGN TEMPERATURE:	SHELL:	230°F	OPERATING TEMPERATURE:	SHELL:	
	TUBES:			TUBES:	

PRESSURE VESSEL SERVICE INFORMATION

SELECT ALL THAT APPLY

☐ Sweet
 ☒ Sour
 ☐ Oil
 ☒ Gas
 ☐ Water
 ☐ Produced Water
 ☐ Steam
 ☐ LPG
 ☐ NGL
 ☐ Propane
 ☐ Condensate
☒ Glycol
 ☐ Amine
 ☐ Pulp
 ☐ Air
 ☐ Other

PRESSURE SAFETY VALVE (PSV) NAMEPLATE DATA

	PSV 1	PSV 2		PSV 1	PSV 2
PSV TAG NUMBER:			PSV SERIAL NO.:	9477-1	
MANUFACTURER:	Taylor		MODEL:	82E5351311	
LOCATION:	Outlet piping		BLOCK VALVE:	☐ Yes ☐ No	☐ Yes ☐ No
SIZE:	1 x 1		CAPACITY:	939 SCFM	
SET PRESSURE:	250 PSI		SERVICE DATE:	06/2015	

INSPECTION INTERVAL

INSPECTION INTERVAL:		PSV SERVICE INTERVAL:	
DATE OF NEXT INSPECTION:			

REPORT CERTIFICATION

The signatures below certify that inspections/tests have been completed in accordance with the identified inspection strategy and that the specified equipment is considered fit for service until the date of next inspection.

	NAME	SIGNATURE	CERTIFICATION	DATE
INSPECTED BY:	Andrew Neis		API 510 # 48747 / IBPV # 0857	September 22, 2025

API 510 PRESSURE VESSEL INSPECTION REPORT

EXTERNAL INSPECTION


DESCRIPTION	CONDITION	COMMENTS
Insulation Verify sealed around manways, nozzles, no damage present, and there is no egress of moisture.	N/A	Vessel is not insulated
External Condition Assess paint condition, areas peeling, record any corrosion, damage, etc. (record location, size and depth of corrosion or damage)	Good	Paint is in good overall condition – no corrosion or mechanical damage – no bare metal.
Leakage Record any leakage at flanges, threaded joints, weep holes on repads, etc.	N/A	No evidence of previous leakage
Saddle/Skirt Assess condition of paint, fire protection, concrete. Look for corrosion, buckling, dents, etc. Look at vessel surface area near supports. Verify no signs of leakage at attachment to vessel and attachment welds are acceptable. Ground wire attached?	Good	Skirt – paint is in good condition – no corrosion, buckling or dents. Attachment welds are acceptable – no sign of leaks. Ground wire attached to skid
Anchor Bolts Hammer tap to ensure secure. Look for cracking in treads or signs of deformation.	Good	All bolts in place and secure
Foundation Check for cracks, spalling, etc.	N/A	
Ladder / Platform Describe general condition, ensure support is secure to vessel, describe any hazards.	N/A	None
Nozzle Assess paint, look for leakage, and ensure stud threads are fully engaged. Record any damage, deflection, etc. Are nozzles gusseted?	Good	Paint is in good condition – no leakage. No damage or deflection
Gauges Ensure gauges are visible, working, no leakage, and suitable for range of MAWP/ Temp.	Good	Gauges are in good condition Pressure gauge 0 – 200 PSI – not a suitable range for MAWP Temperature gauge 0 – 250° F
External Piping Ensure pipe is well supported. All clamps, supports, shoes, etc. in place. Look for evidence of structural overload, deflection, etc. Paint condition, external corrosion?	Good	Piping is well supported – all clamps, supports, and shoes are in place. No evidence of structural overload. Paint is in good condition – no corrosion
Valving Ensure no leaks are visible. Valves are properly supported and chained if necessary.	Good	No leaks – well supported
Sight Glasses, Bridles, Auxiliary Equipment Are sight glasses clean? Any leakage or concerning vibration? Ensure any added supports are intact.	Good	Sight glass is clean and well supported – no evidence of leaks
PSV Ensure PSV is set at pressure at or below that of vessel. Discharge piping is same size as inlet to valve and is properly supported and routed. Ensure no block valves between PSV and vessel or if there are they are locked open.		PSV is set at vessel MAWP – discharge piping is properly supported and routed – no block valve. PSV is due for service
VISUAL EXTERNAL SUMMARY:	Visual external inspection carried out – vessel is in good overall condition. Equipment has been out of service for several years. No corrosion or mechanical damage. No sign of leaks. No items of concern. PSV requires service.	
	Fit for Service	
RECOMMENDATIONS:	None	
NCRs / CORRECTIVE ACTIONS / REPAIRS REQUIRED:	None	
SUMMARY OF NDE RESULTS:	Ultrasonic thickness testing carried out – no metal thickness detected below nominal minus corrosion allowance	

API 510 PRESSURE VESSEL INSPECTION REPORT

PHOTOS



Skid Overview

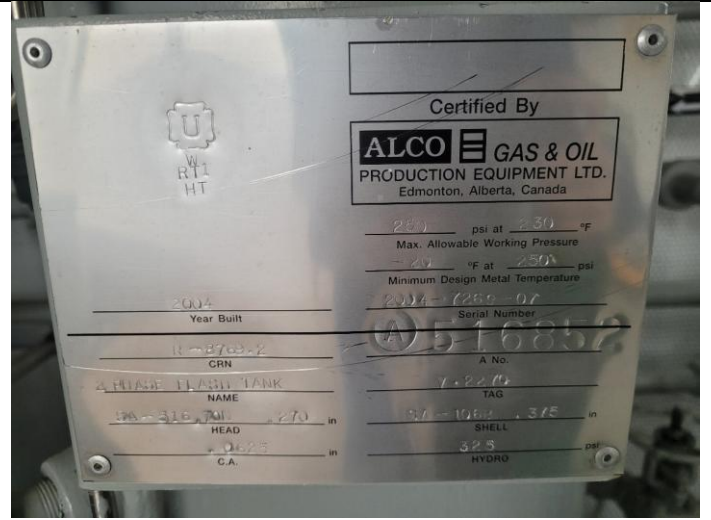

Nameplate




Vessel Overview



Skirt

API 510 PRESSURE VESSEL INSPECTION REPORT

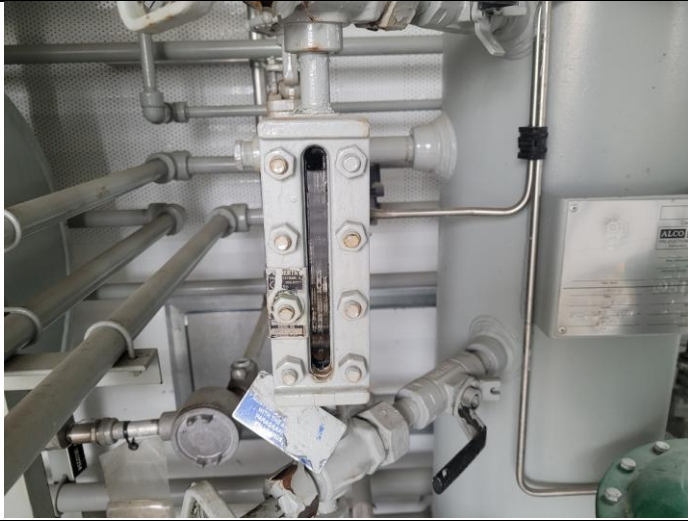

Sight Glass



Pressure Gauge




Temperature Gauge



PSV



PSV data

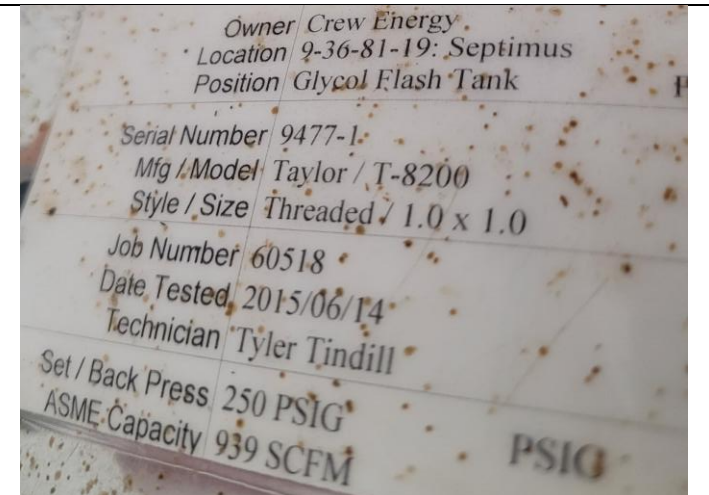

PSV service tag