

NOTE:

1. PLACEMENT ON A LEVEL SURFACE FREE OF OBSTRUCTIONS (INCLUDING SNOW, FOR WINTER OPERATION) OR AIR-CIRCULATION ENSURES RATE PERFORMANCE, RELIABLE OPERATION AND EASE OF MAINTENANCE. SITE RESTRICTIONS MAY COMPROMISED MINIMUM CLEARANCES INDICATED BELOW, RESULTING IN UNPREDICTABLE AIR FLOW PATTERNS AND POSSIBLE DIMINISHED PERFORMANCE. JOHNSON CONTROLS UNIT CONTROLS WILL OPTIMIZE OPERATION WITHOUT NUISANCE HIGH PRESSURE SAFETY CUTOUT. HOWEVER, THE SYSTEM DESIGNER MUST CONSIDER POTENTIAL PERFORMANCE DEGRADATION.






1.1. RECOMMENDED MINIMUM CLEARANCES:

- 1.1.1. COIL SIDE TO WALL - 1828.8 MM [72.00"]
- 1.1.2. COMPRESSOR SIDE TO WALL - 1219.2 MM [48.00"]
- 1.1.3. CONTROL PANEL TO WALL - 1828.8 MM [72.00"]
- 1.1.4. TOP - NO OBSTRUCTIONS ALLOWED.
- 1.1.5. DISTANCE BETWEEN ADJACENT UNITS - 3048 MM [120.00"]
- 1.1.6. NO MORE THAT ONE ADJACENT WALL MAY BE HIGHER THAN UNIT.

2. WEIGHT AND CENTER OF GRAVITY- REF TO PERFORMANCE SPECIFICATION

3. FOR MONTERREY, MEXICO AND SAN ANTONIO, TEXAS BUILDS ONLY

FOR UNITS WITH OR WITHOUT OPTIONAL PUMP PACKAGE

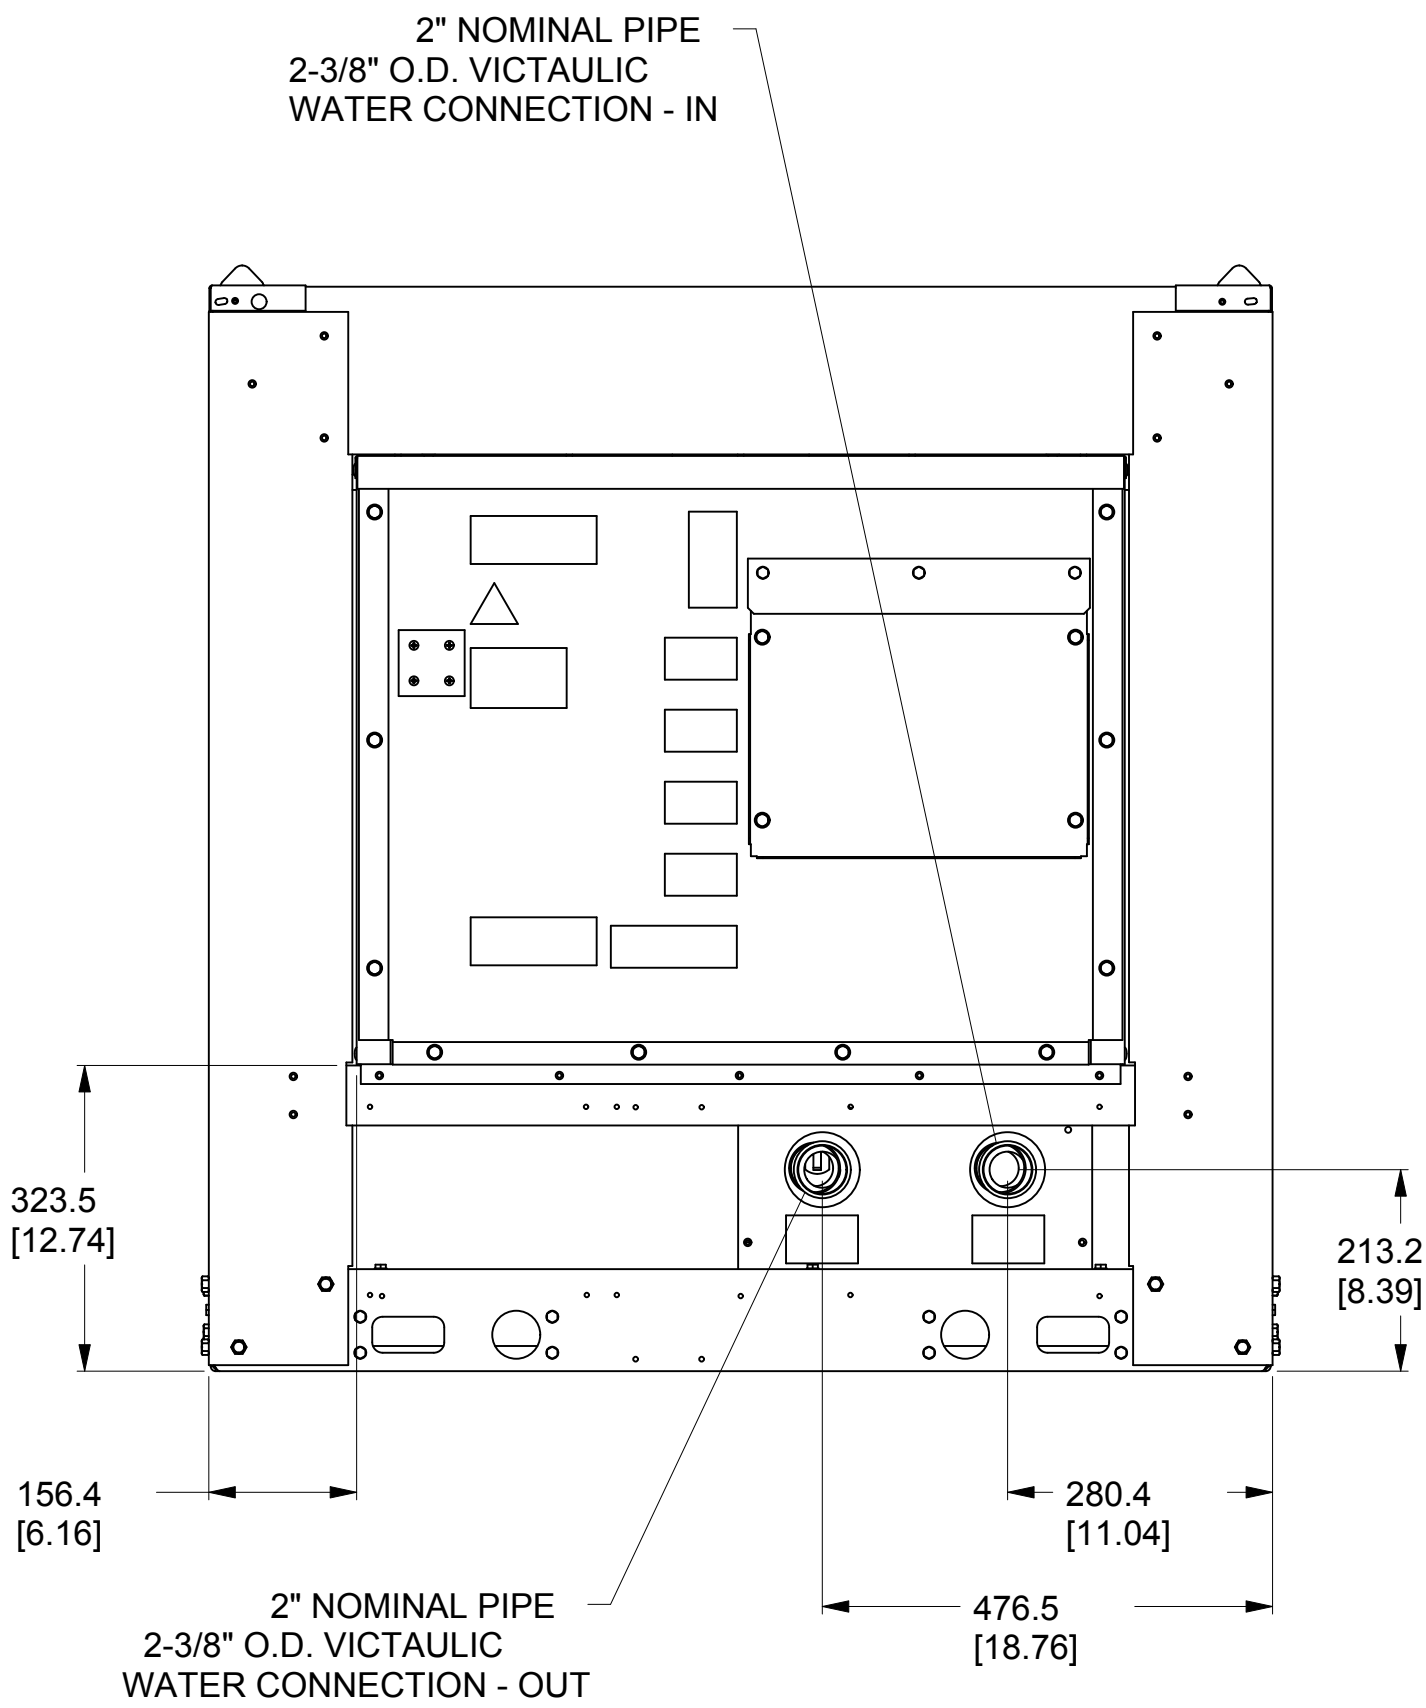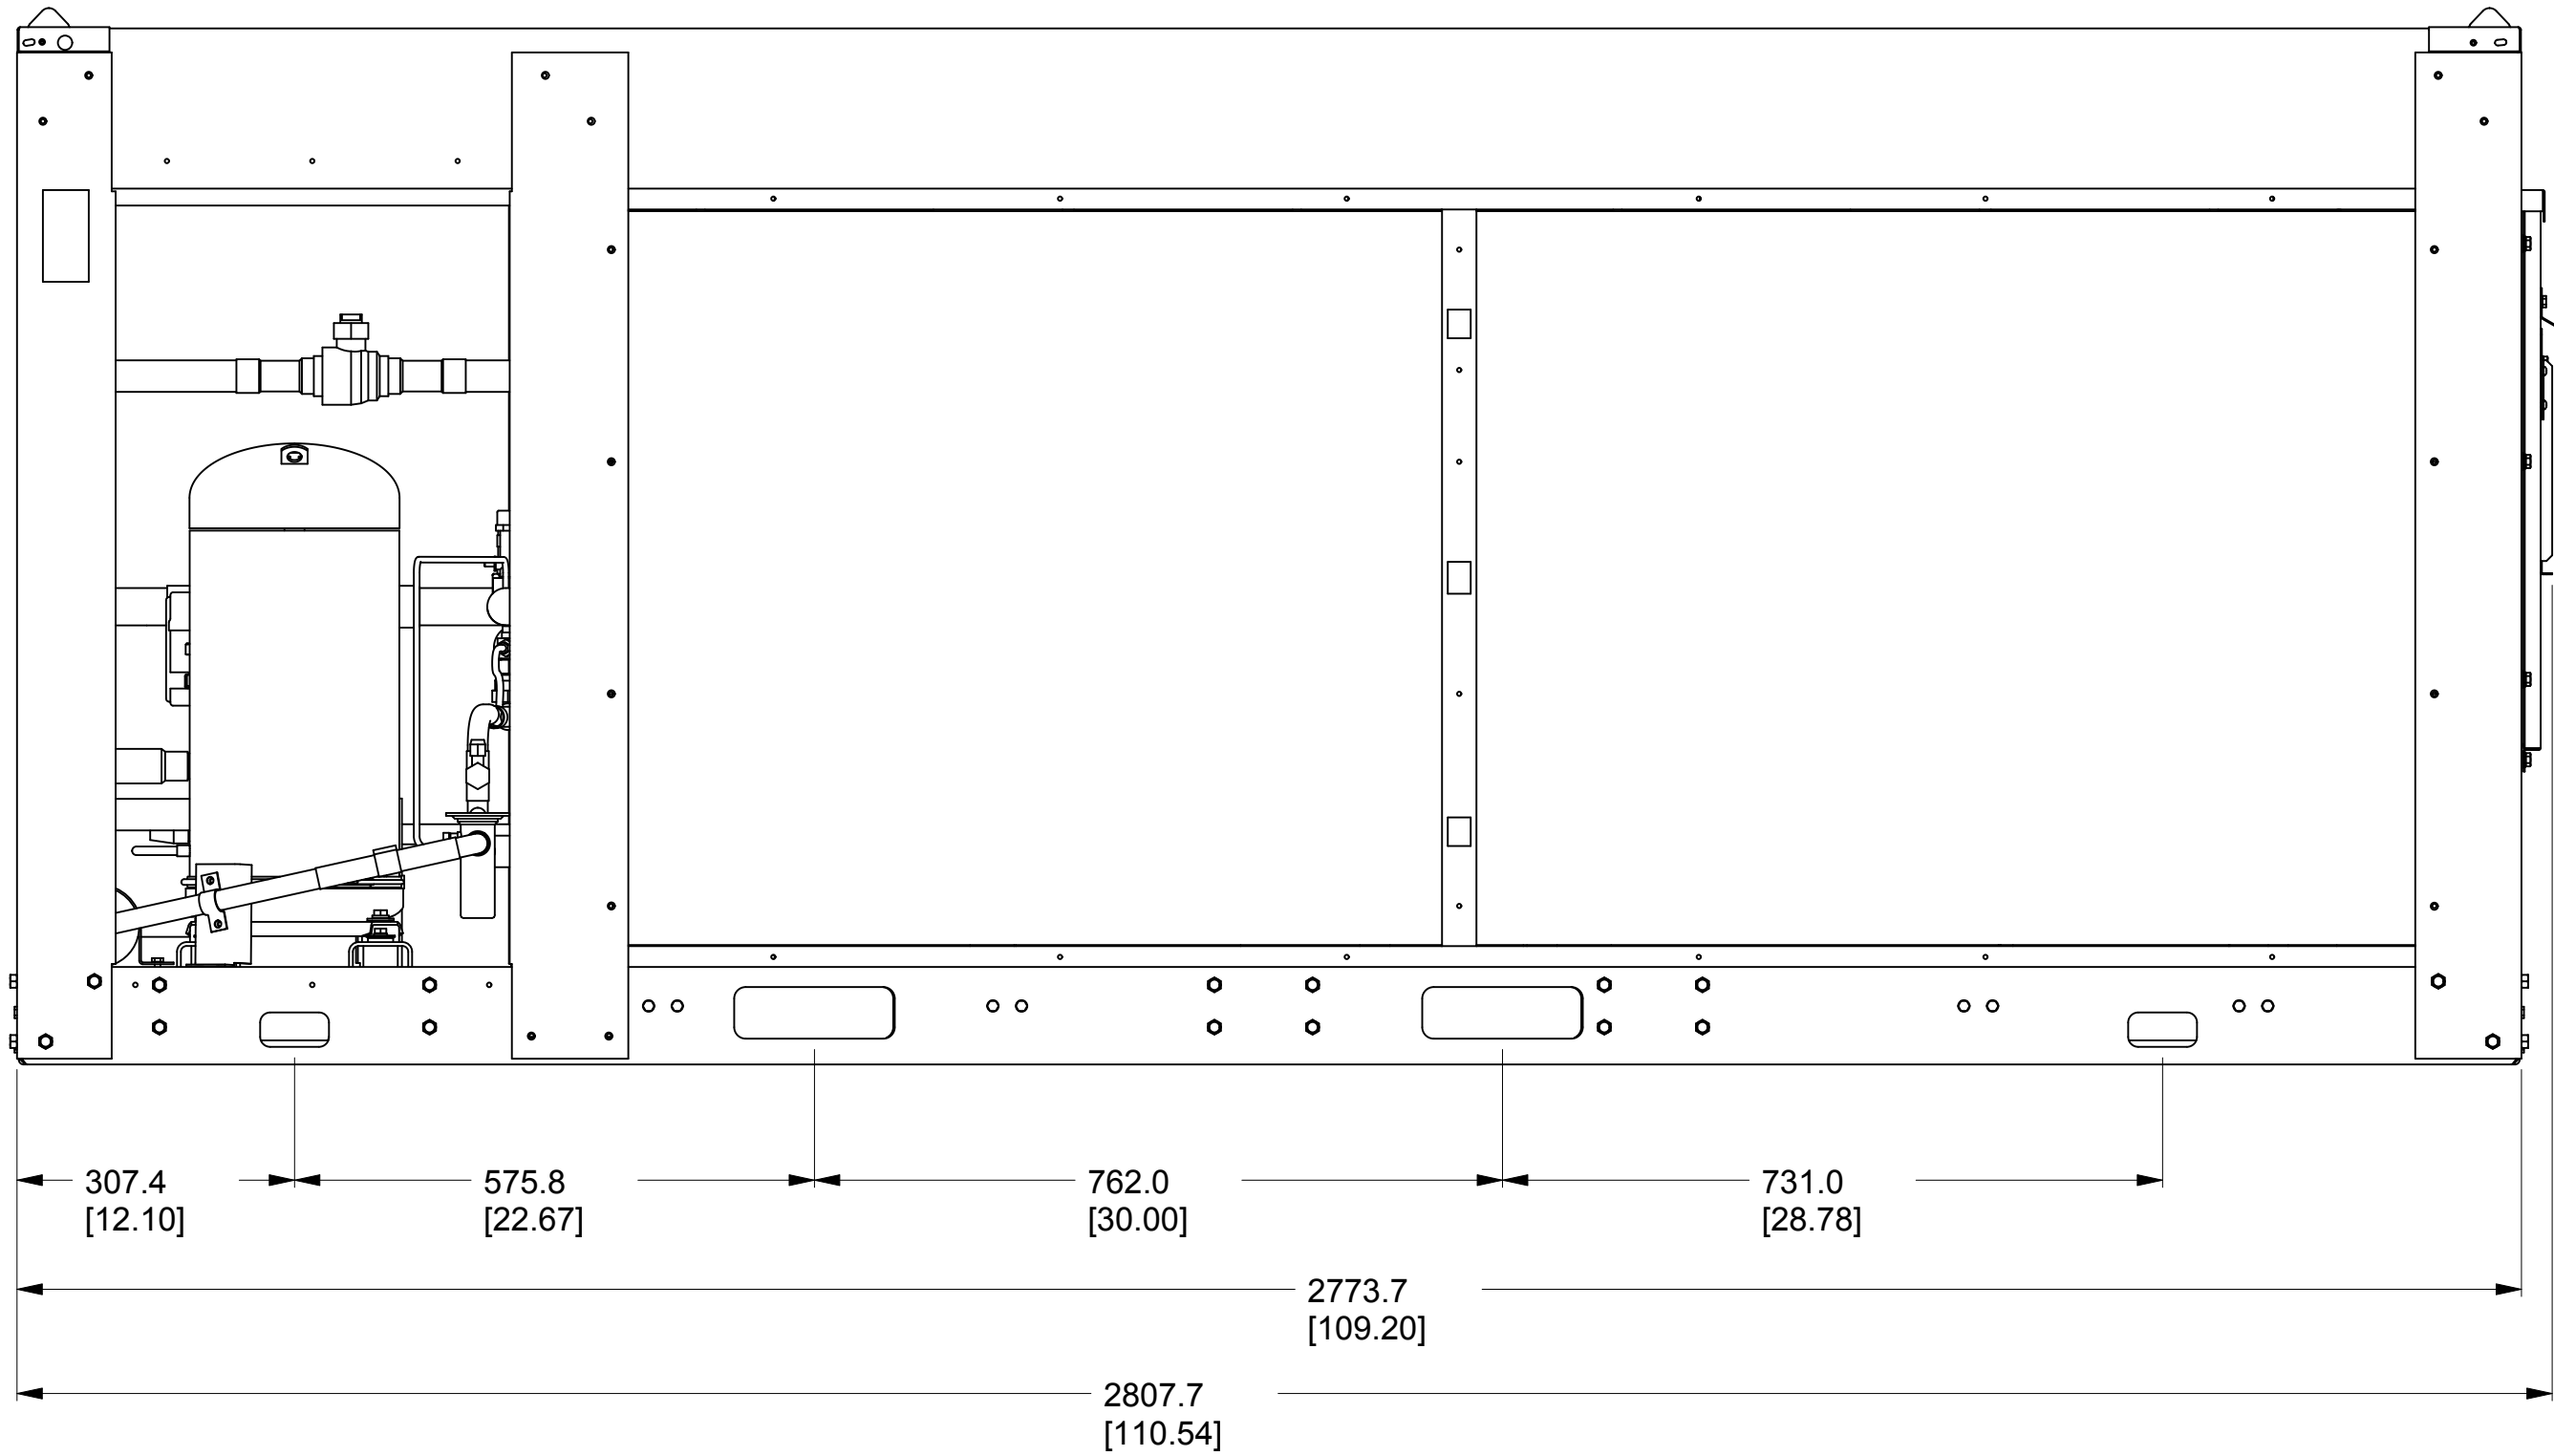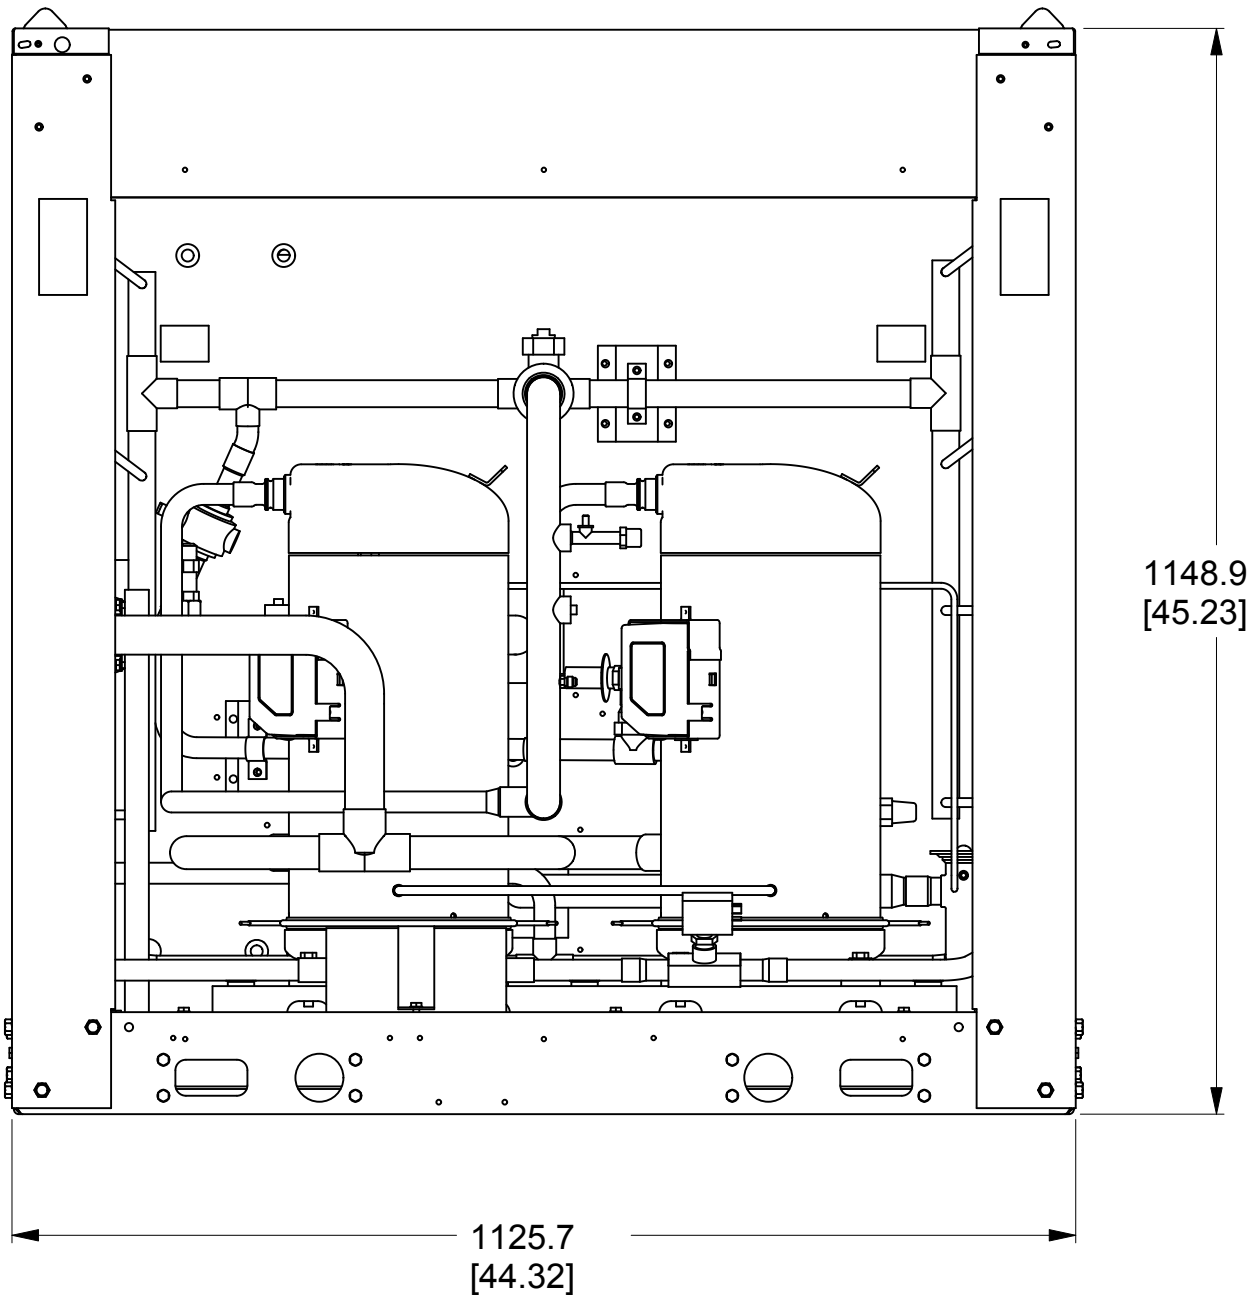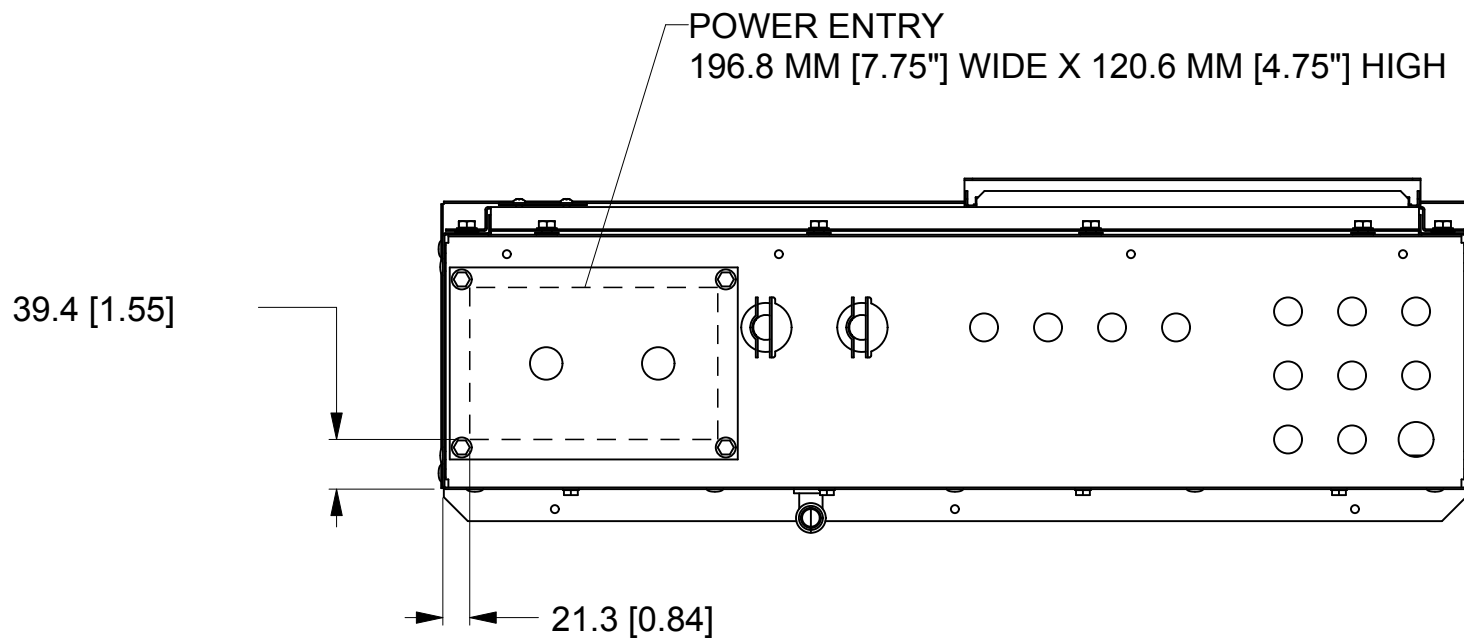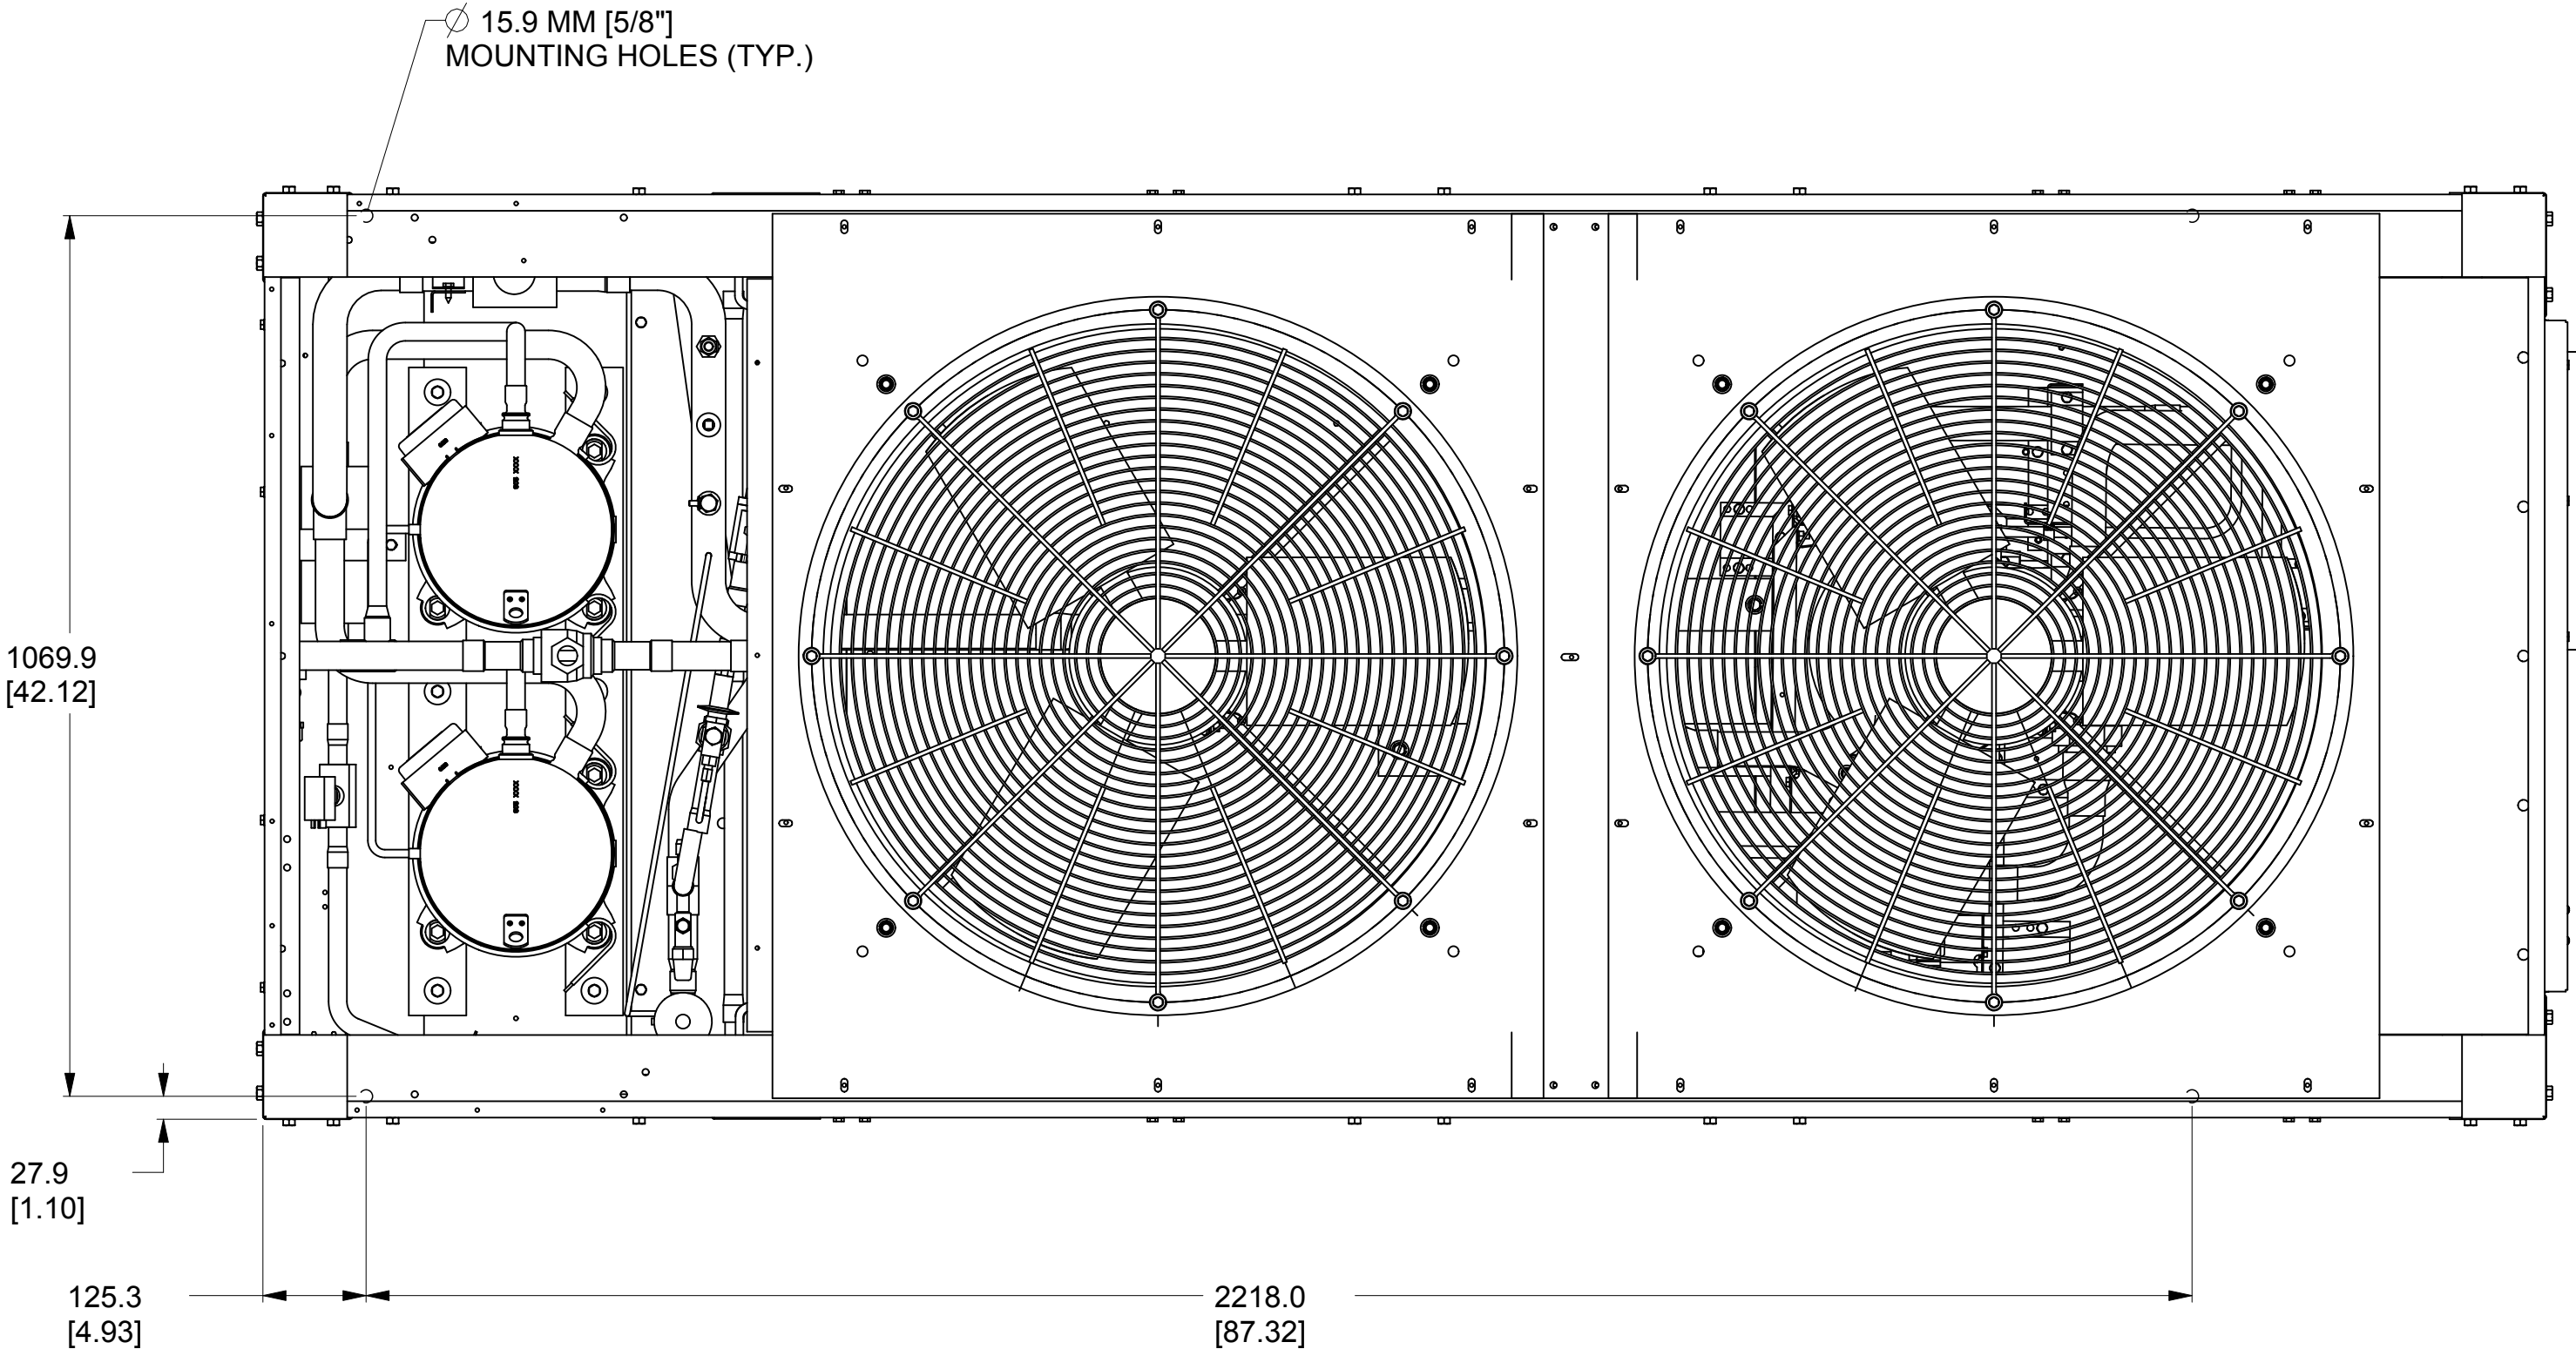

THIS DRAWING PERTAINS TO THE FOLLOWING UNITS


YCAL 0019

YCAL 0022

REV.	DATE	EC. NO.	DR.	CHK.	ENG.
A	17-NOV-2014	DX14-0394	ETE	DLO	

ADDED NOTE ABOUT OPTIONAL PUMP PACKAGE

"ALL PROPRIETARY RIGHTS IN THE SUBJECT MATTER HEREOF ARE RESERVED AND NO PERMISSION IS GRANTED TO REPRODUCE THIS PRINT IN WHOLE OR IN ANY PART, OR DISCLOSE ANY OF THE INFORMATION UPON IT TO OTHERS WITHOUT WRITTEN RELEASE BY JOHNSON CONTROLS INCORPORATED"



THIRD ANGLE



JOHNSON CONTROLS - BUILDING EFFICIENCY
507 EAST MICHIGAN STREET, MILWAUKEE, WI, 53202 USA

DO NOT SCALE

MODEL D.B. NEWSWANGER 15-APR-2014

CHKD D.B. NEWSWANGER 15-APR-2014

ENG

SCALE: 1:000

MASS (kg): 2930.812

ORIG. NO.: 035-23980-001

YCAL PRODUCT DRAWING

CAGE NUMBER

DRAWING NUMBER

REVISION

VERSION

Eng Chg

MATERIAL

ENG. STD.

PART NO.

CUT SIZE

035-23980-001

SHEET 1 OF 1

Eng Chg