

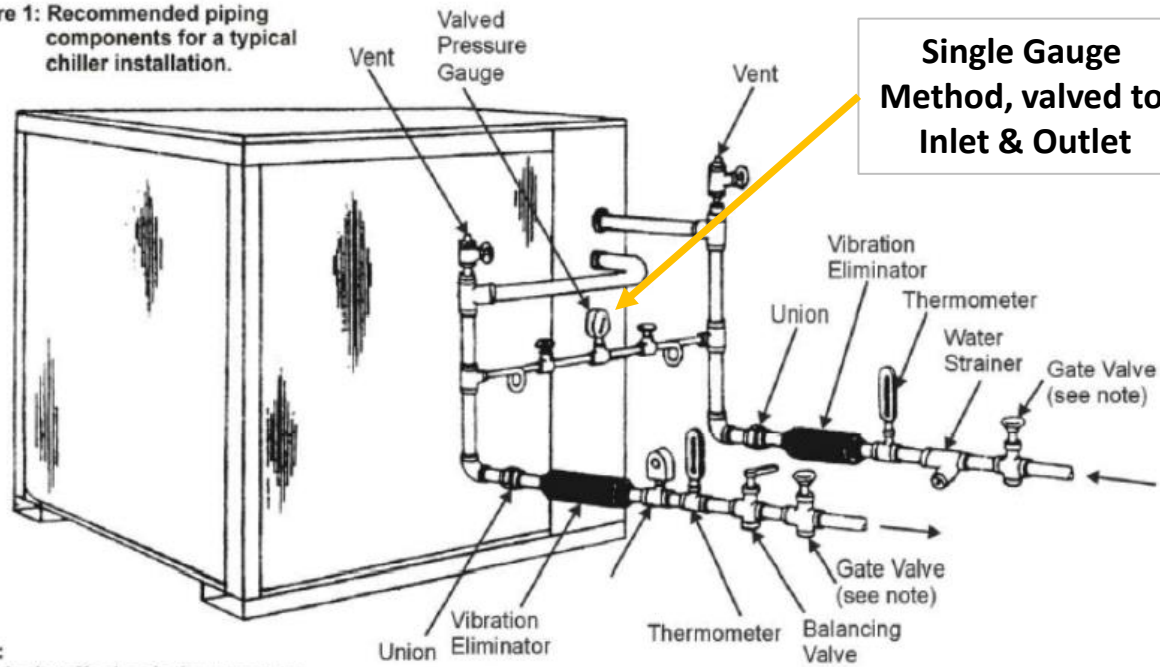


Figure 1: Recommended piping components for a typical chiller installation.

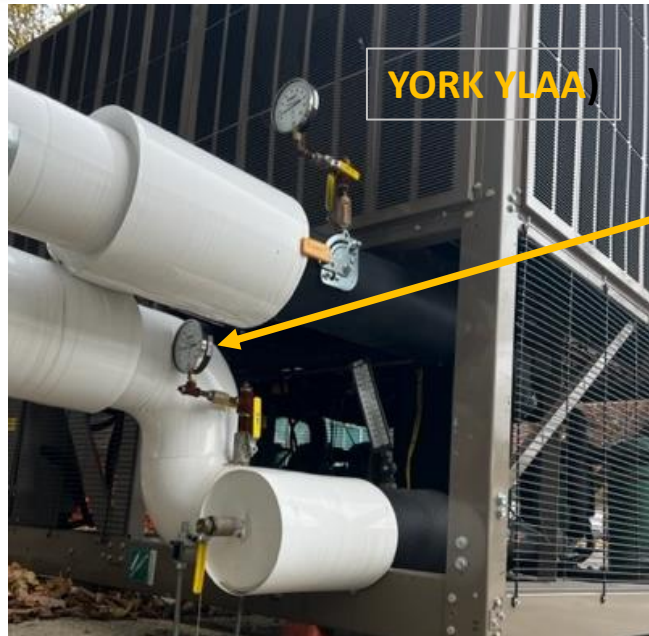

Note:
Provide shutoff valves in the evaporator inlet and outlet piping to facilitate water temperature sensor removal.

Single Gauge Method, valved to Inlet & Outlet

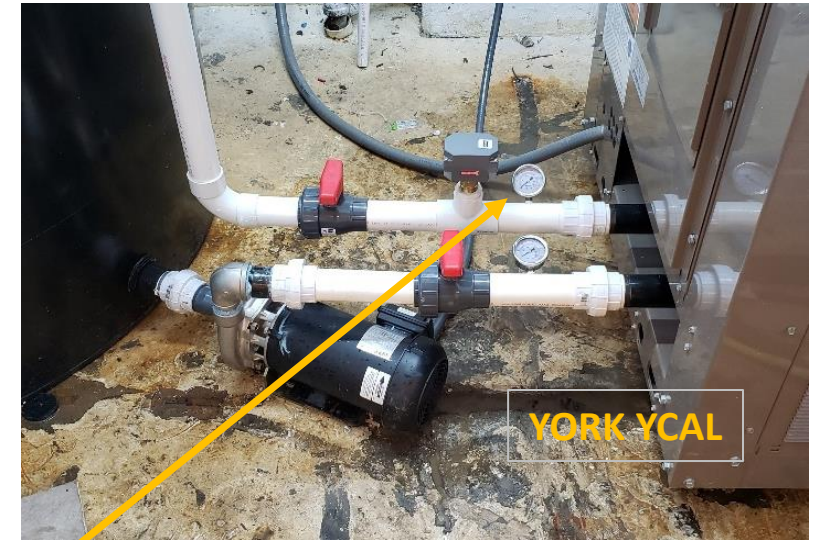

Pressure Gauges on Outlet (other gauge In photos on Inlet)

Examples of Pressure Gauge(s) on Inlet & Outlet of Chilled water piping to allow measuring of pressure drop.

