

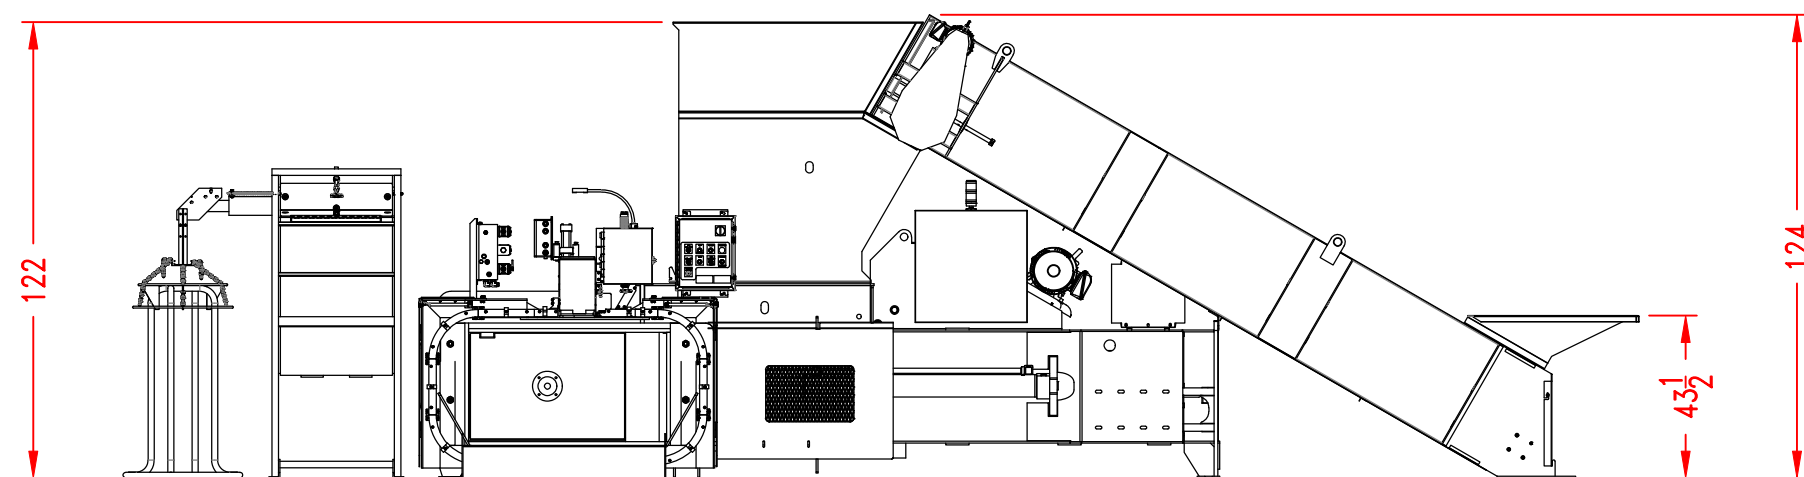


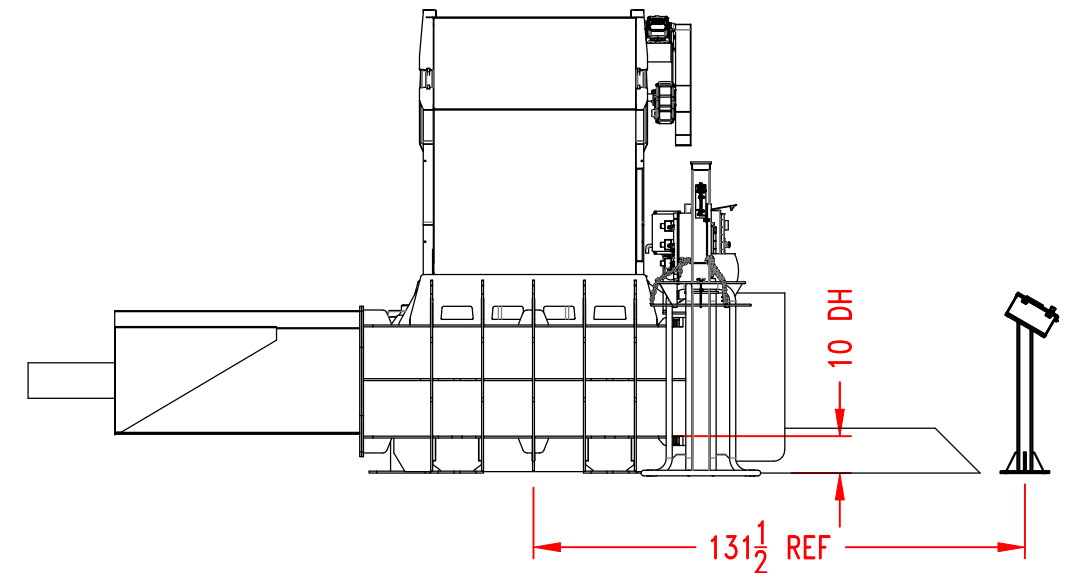

Pedestal and Wire Spool Locations for Reference ONLY
 Pedestal can be Moved Up to Approx 10' from Electrical Cabinet
 Wire Spool can be Moved Up to Approx. 15' from Tier

APPROVED BY:
 Name: _____
 Signature: _____
 Date: _____ V: _____
 PH: _____ Hz: _____

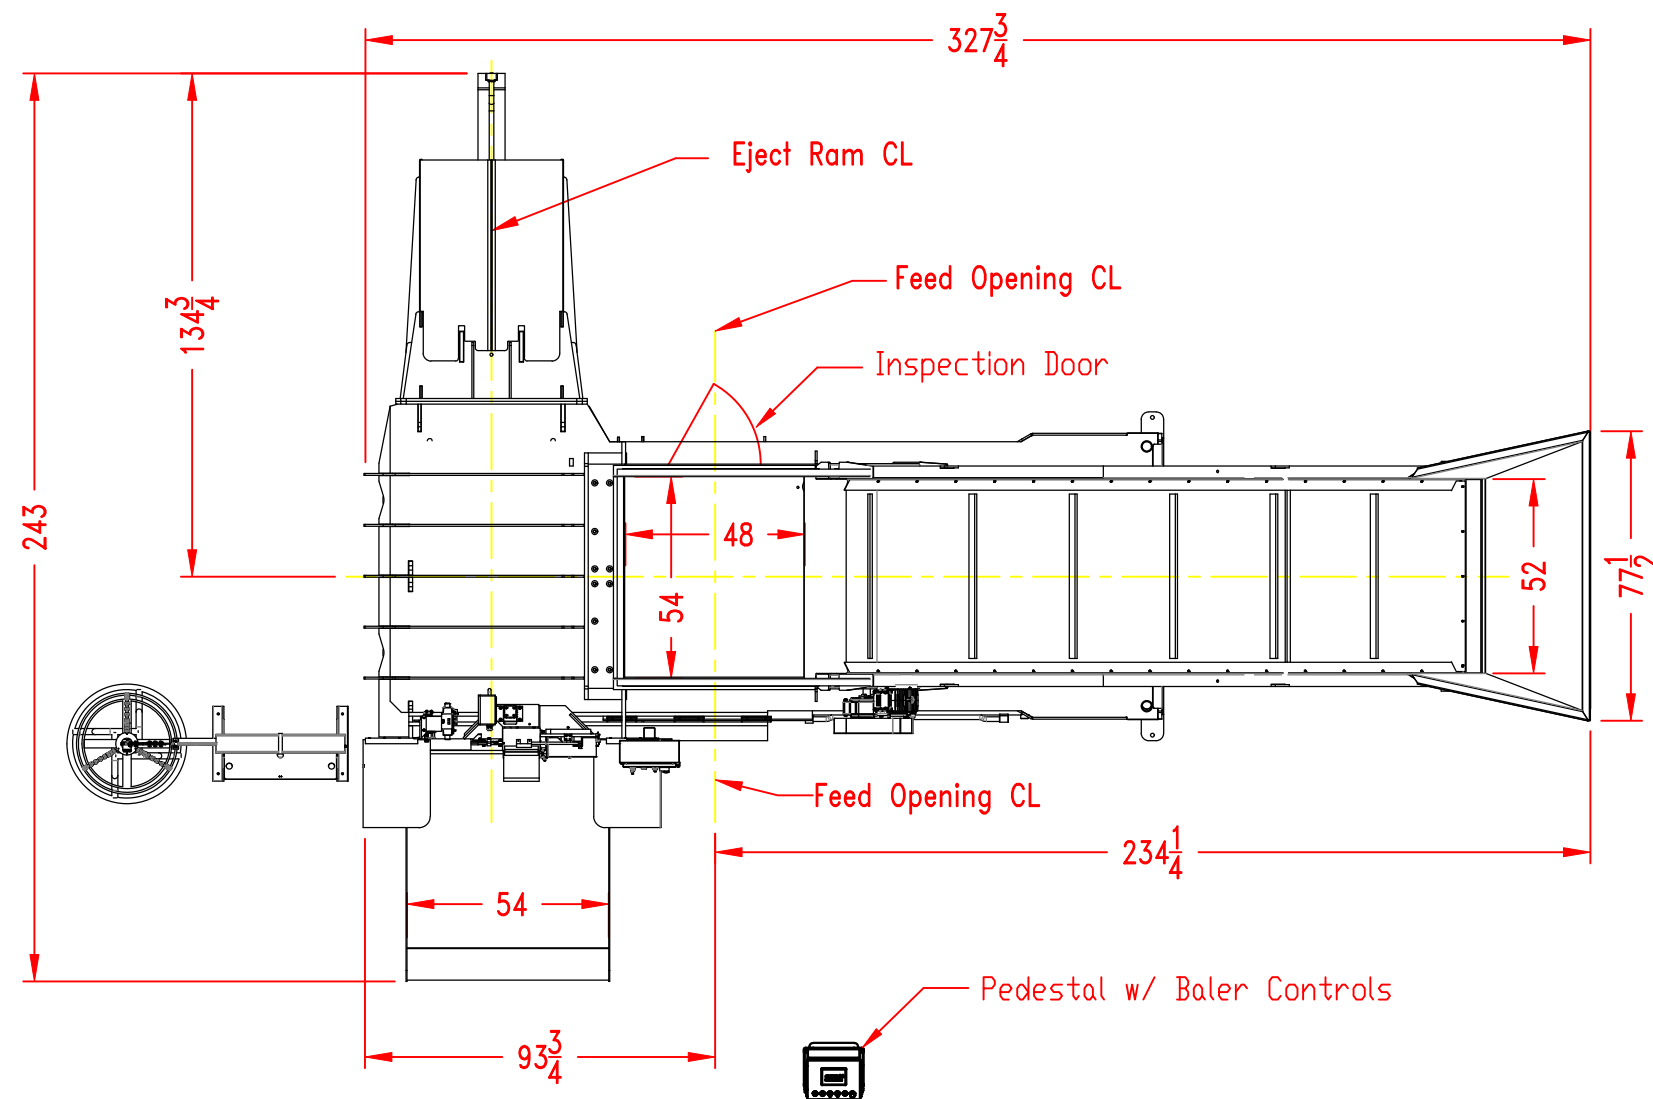

ProPak 2R185

A	Update overall views	6/6/24
ITEM	REVISION	DATE

DRAWN RAB	DATE 1/24/13	SCALE 1 : 75
CHECKED	DATE	DRAWING NO. S4031001