



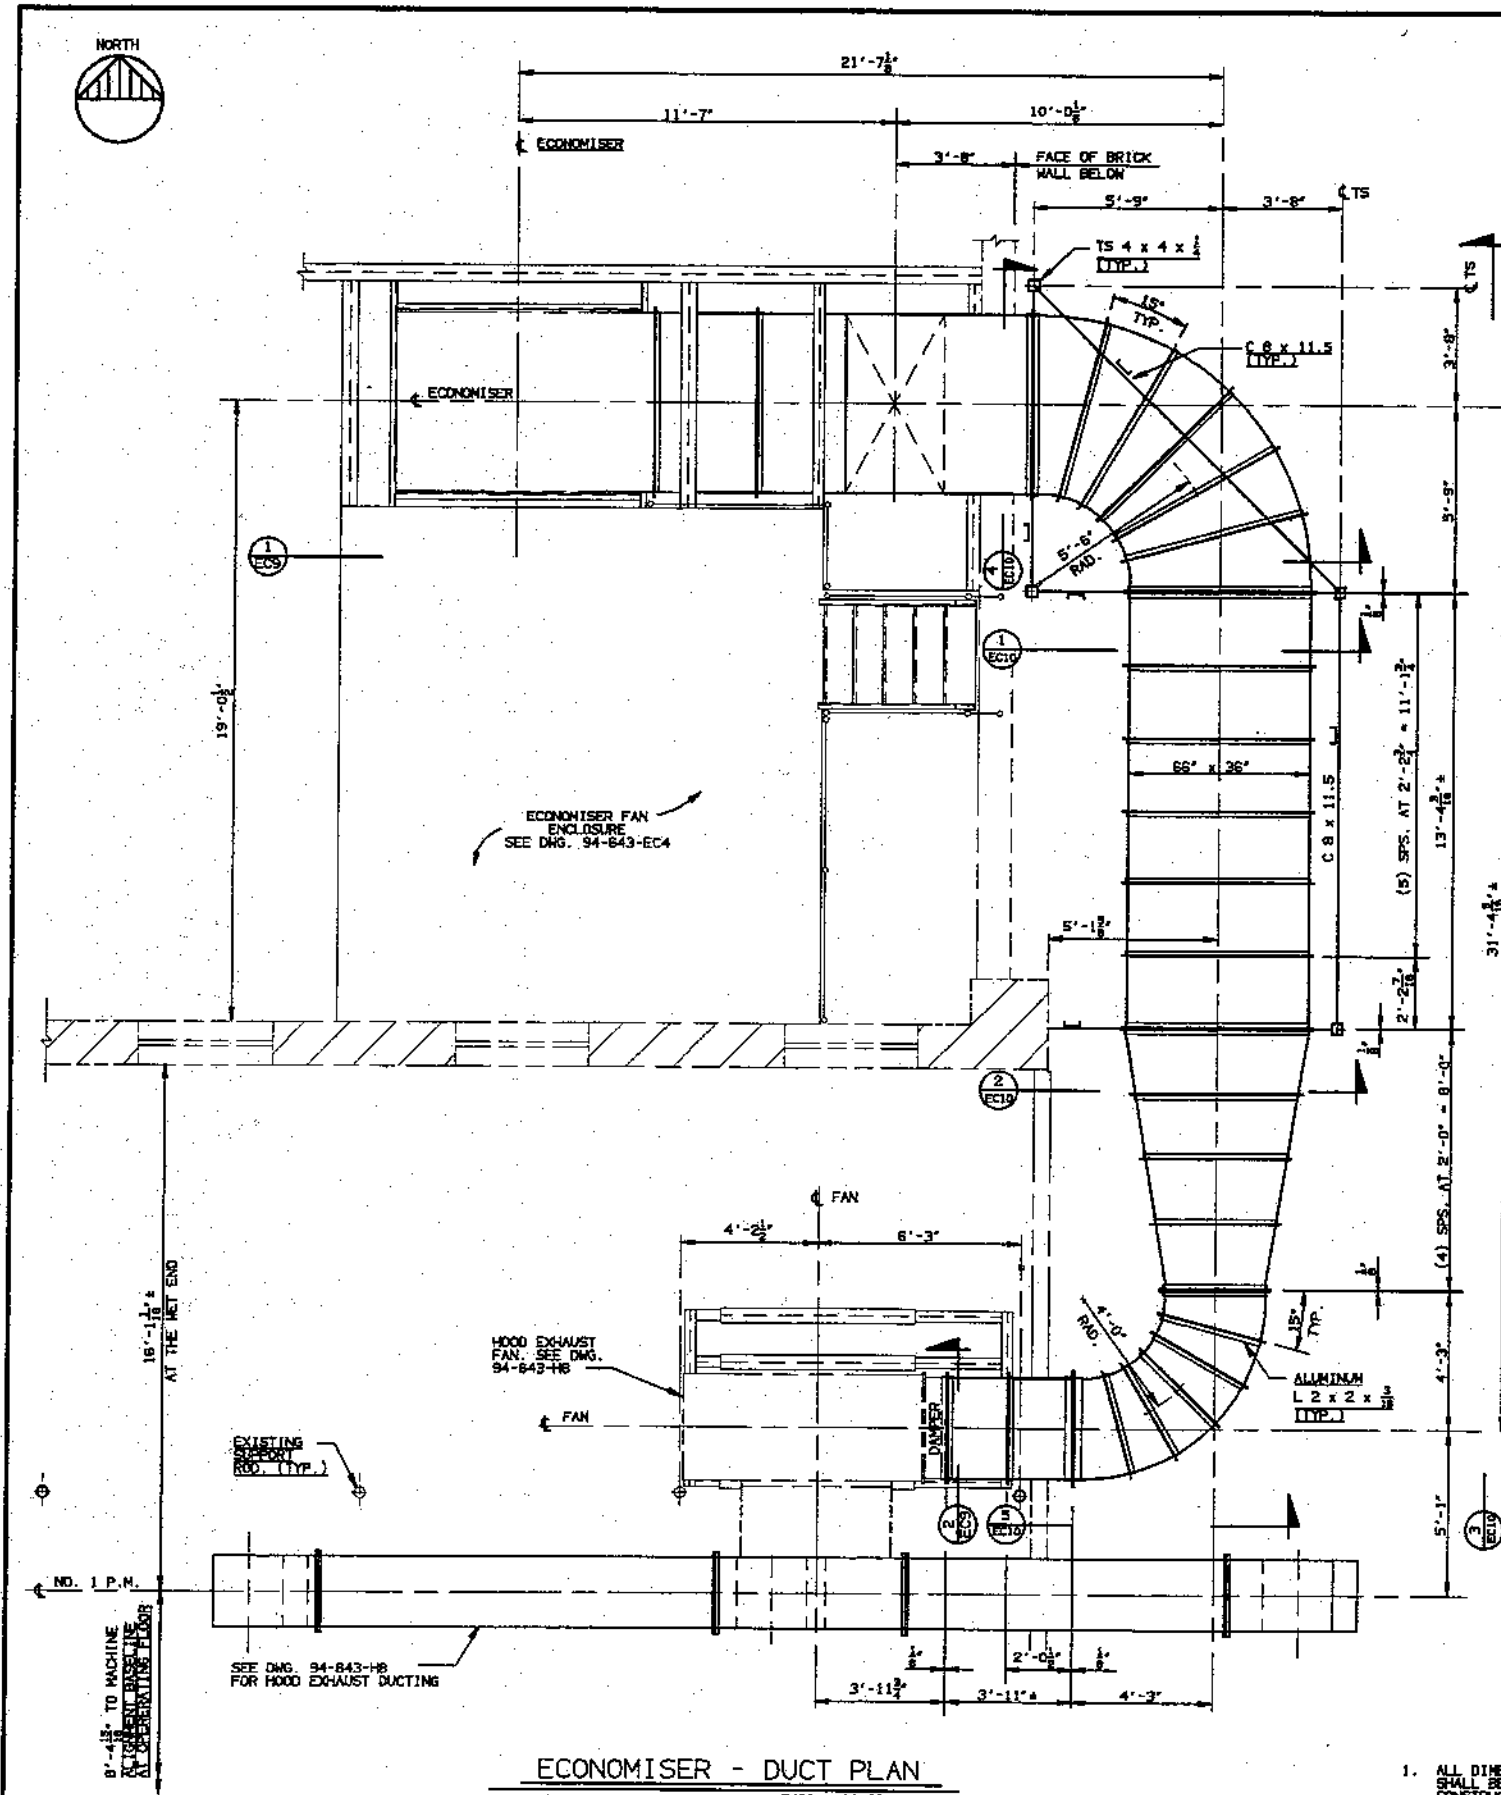


ECONOMISER - DUCT PLAN
3/8" = 1'-0"


FAN DISCHARGE
AND DUCT
ELEV. = 125'-2 1/2"

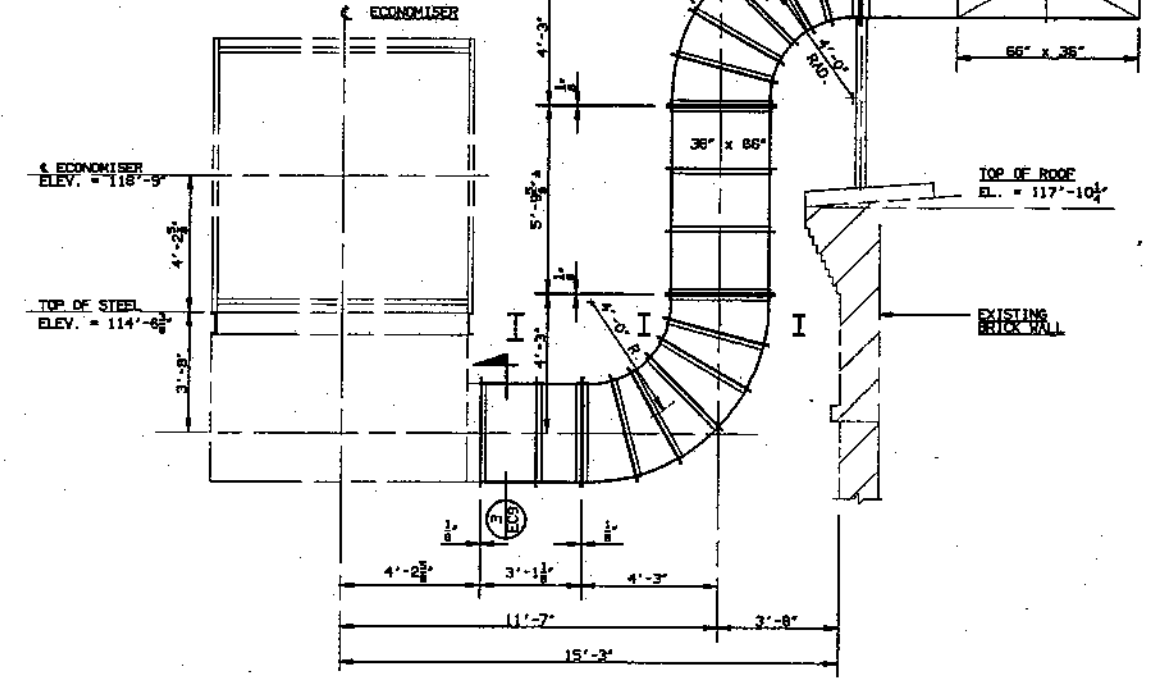

CROSS SECTION
3/8" = 1'-0"

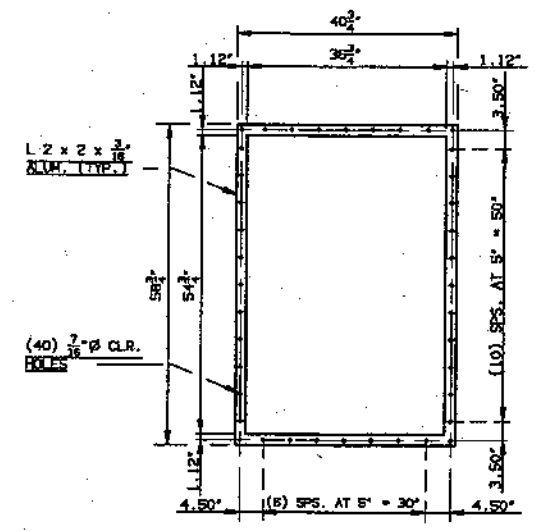

CROSS SECTION
TYP. (3) PLACES 3/4" = 1'-0"

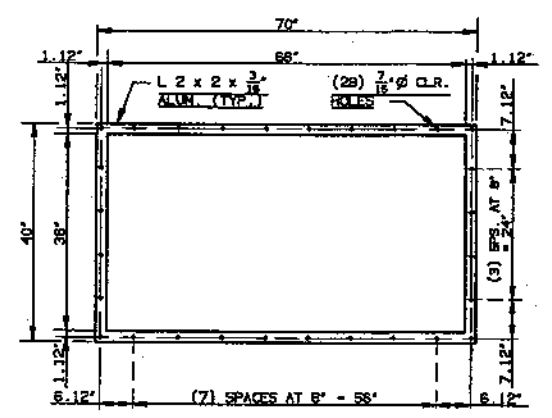

CROSS SECTION
TYP. (7) PLACES 3/4" = 1'-0"

GENERAL NOTES

1. ALL DIMENSIONS ARE PLUS OR MINUS AND SHALL BE FIELD VERIFIED PRIOR TO CONSTRUCTION AND INSTALLATION.
2. SEE DRAWING 94-643-H8 FOR EXHAUST DUCT PLAN AND ELEVATION.
3. ALL WALL AND FLOORING THAT IS TO REMAIN AFTER INSTALLATION OF EQUIPMENT, DUCTING, ETC. SHALL BE PATCHED TO MATCH EXISTING MATERIAL.
4. ALL DUCTING TO BE ALUMINUM - 18 GA. (.040) FOR DUCT UP TO 30", 16 GA. (.051) FOR DUCT ABOVE 31".
5. ALL DUCTING TO BE SUPPORTED ACCORDING TO STANDARD SPECIFICATIONS AND PROPERLY INSTALLED.
6. ALL MILD STEEL PARTS TO BE PRIMED AND PAINTED.

POTASH-DELMOLINO-DAVIS INC. Industrial Design Services	
Dallas, Texas 01226	01226
ROISING PAPER COMPANY HOUSATONIC, MA	
NO. 1 P.M. DRYER SECTION MODIFICATIONS	SCALE: AS NOTED DRAWN BY: MTK CHECKED BY: DPM/CFP
ECONOMISER - DUCT PLAN AND CROSS SECTIONS	
DATE: 04-10-95	DWG. NO.: 10 DRAWING NUMBER: 94-643-ECS

REV.	DESCRIPTION	DATE	BY